

LEGIONELLA RISK ASSESSMENT



Geo Tag: ,
Customer: Believe Housing
Site: Donnini House Sheltersed Housing, Easington Colliery, Peterlee, SR8 3ER
Date: 7th November 2023
Risk Assessor: Carleton Waite
Report No: J051366 - 643228

Copyright © 2020 by HBE. All rights reserved.

Information and images contained within this report published by Healthy Buildings Ireland Ltd trading as HBE are subject to copyright and the property of HBE.

HBE authorises you to copy documents or pages published by HBE in this report for your organisation's internal use only. Any such copy shall retain all copyrights and other proprietary notices, and any disclaimer contained thereon. None of the content, format or layout of these pages may be photocopied, incorporated into, reproduced on, or stored in any other document, website, electronic retrieval system, or be incorporated in any other publication, including tender documentation, whether in hard copy or electronic form. You may not, without our express written permission, reproduce the information contained within this report, modify or re-use text or graphics used in this report. For permission requests, write to the publisher, addressed "Attention: Legal Department," at the address below.

Group Admin Head Office:
Craigmore House,
19 Millvale Road,
Newry,
Co. Down
BT35 7NH

Contents

1	Introduction	4
1.1	General Introduction and Survey Objectives	4
1.2	Relevant Legislation and Normative References	5
1.3	Executive Summary	7
1.4	Allocation of Risk Rating	9
1.5	Scope and Application of Risk Assessment	13
1.6	Risk Assessment Handover	14
2	Overview of Site	15
2.1	Site Details	15
2.2	Lines of Communication	16
2.3	Record Systems	19
3	Recommendations and Requirements	21
3.1	Remedial Action to Water Systems	21
4	Appraisal of Water Systems	23
4.1	Overview of Water Systems	23
4.2	Water System Details	26
5	Testing of Water Systems	100
5.1	Water Temperature Measurements	100
6	Appendices	101
6.1	List of Abbreviations and Acronyms	101
6.2	Additional Certification	104
6.3	Schematic Drawings	105
6.4	Legionella Escalation Procedure	106
6.5	Action to take if there is an outbreak of Legionellosis	107

1 Introduction

1.1 General Introduction and Survey Objectives

Legionellosis is the collective term used to describe the group of diseases caused by Legionella bacteria. Legionellosis is contracted by inhaling the bacteria contained in aerosols from contaminated water systems.

There is a chain of events (Causal Chain) leading to an individual becoming infected with Legionellosis:

- The water system needs to become contaminated with the bacteria
- Conditions have to exist within the water system for the amplification of the bacteria to sufficient concentrations to cause infection
- The contaminated water usually needs to be dispersed into droplets fine enough to form an aerosol for transmission into the lungs
- Inhalation of contaminated aerosols or, in rare cases, aspiration of contaminated water

If exposed individuals have a suppressed or depleted immune system they will be more susceptible to infections.

HBE have completed this Risk Assessment in accordance with the UK Health & Safety Executive recommendations contained within the document '*Legionnaires' disease – The control of Legionella bacteria in water systems – Approved code of practice & guidance' on Regulations L8 (Fourth edition), HSG 274 Part 1–3 and Health Protection Surveillance Centre, National Guidelines for the Control of Legionellosis in Ireland, 2009.*

The objectives of this survey are as follows:

1. To enable the responsible person to make an informed decision regarding the adequacy of precautions currently in place to minimise the risk to health from Legionellosis to both building occupants and the general public.
2. To provide documented evidence as to the state of the water systems, control systems and management structure at the time of the assessment.
3. To provide guidance and recommendations on how to control and minimise future risk of Legionella proliferation by:
 - Identifying and assessing likely sources of risk
 - Recommending schemes to help control the risk
 - Suggesting a suitable routine monitoring programme
 - Checking current record keeping procedures
 - Clarifying lines of responsibility
 - Identifying training deficiencies
 - Providing recommendations
4. It also enables the person on whom the statutory duty falls to demonstrate that all the pertinent factors, and the steps needed to prevent or minimise the risk, have been considered.

1.2 Relevant Legislation and Normative References

This survey has been completed by HBE with reference to current legislation and best practice guidelines. The specific legislation that is referred to in this report includes:

England / Scotland / Wales

1. The Health & Safety at Work Etc. Act 1974.
2. The Control of Substances Hazardous to Health Regulations 2002 (COSHH).
3. The Management of Health and Safety at Work Regulations 1999.
4. The Notification of Cooling Towers and Evaporative Condensers Regulations 1992.

Northern Ireland

1. The Health & Safety at Work (Northern Ireland) Order 1978.
2. The Control of Substances Hazardous to Health Regulations (Northern Ireland) 2003 (COSHH [NI]).
3. The Management of Health & Safety at Work Regulations (Northern Ireland) 2000.
4. The Notification of Cooling Towers and Evaporative Condensers Regulations 1992.

Republic of Ireland

1. Statutory Instrument (S.I.) No. 10 of 2005 – The Safety, Health and Welfare at Work Act 2005.
2. Statutory Instrument (S.I.) No. 299 of 2007 – The Safety, Health and Welfare at Work (General Applications) Regulations 2007.
3. Statutory Instrument (S.I.) No. 619 of 2001 – The Safety, Health and Welfare at Work (Chemical Agents) Regulations 2001.
4. Statutory Instrument (S.I.) No. 572 of 2013 – The Safety, Health and Welfare at Work (Biological Agents) Regulations, 2013.
5. Statutory Instrument (S.I.) No. 370 of 2016 – The Safety, Health and Welfare at Work (Reporting of Accidents and Dangerous Occurrences) Regulations 2016.

Guidance

1. HSE document L8 (Fourth edition) – Legionnaires Disease, The control of Legionella bacteria in water systems: Approved Code of Practice and Guidance on Regulations.
2. HSE document HSG274 Part 1 – The control of Legionella bacteria in evaporative cooling systems.
3. HSE document HSG274 Part 2 – The control of Legionella bacteria in hot and cold water systems.
4. HSE document HSG274 Part 3 – The control of Legionella bacteria in other risk systems.
5. National Guidelines for the Control of Legionellosis in Ireland, Published by Health Protection Surveillance Centre (HPSC), 2009.
6. BS 8580-1:2019 Water quality. Risk assessments for Legionella control. Code of Practice.
7. BS 8558:2015 - Guide to the design, installation, testing and maintenance of services supplying water for domestic use within buildings and their curtilages.
8. BS 8554:2015 - Code of practice for the sampling and monitoring of hot and cold water services in buildings.
9. BS PD 855468:2015 - Guide to the flushing and disinfection of services supplying water for domestic use within buildings and their curtilages.
10. TM 13:2013 CIBSE Technical Memorandum - Minimising the Risk of Legionnaires Disease.
11. WMSoc Guidance Documents.
12. UK HSE document “Working safely with metalworking fluids - good practice manual” (2011).
13. BS 7592:2022 Sampling for Legionella bacteria in water systems - code of practice.
14. HSE document HSG 282 The control of Legionella and other infectious agents in spa-pool systems.
15. The Water Supply (Water Quality) Regulations 2010.
16. The Water Supplies (Water Quality) (Scotland) Regulations 2011.
17. The Water Supply (Water Fittings) Regulations 1999.
18. BSEN 671-1-2012 Fixed Fire Fighting Systems.
19. BSEN12845-2004-A2-2009 Fixed Fire Fighting Systems Design and Maintenance.
20. BSEN 806-1 Specification for installations inside buildings conveying water for human consumption.
21. ANSI Z 358.1 2009 Drench Showers, Eyewash, Eye / Face Wash, Portable Eyewash, and Combination Eyewash & Drench Shower units.
22. Water for Scotland 2nd Edition.
23. Private Water Supply Scotland: Technical manual.

1.3 Executive Summary

HBE have been contracted by Believe Housing to carry out a comprehensive Legionella and Water Hygiene Risk Assessment on domestic water systems within Donnini House Sheltered Housing, Easington Colliery, Peterlee, SR8 3ER as directed by the customer, in accordance with the HSE Approved Codes of Practice & Guidance on Regulations document L8 (*Fourth edition*): *the control of Legionella bacteria in water systems / HSG 274 / National Guidelines for the Control of Legionellosis* in Ireland, Published by Health Protection Surveillance Centre (HPSC), 2009 and Believe Housing tender / order specification.

At present full lines of communication for the Duty Holder, Responsible Person and Deputy Responsible Person involved in the implementation of the legionella control scheme have been put in place.

Site personnel involved in the implementation and undertaking tasks associated with a legionella control scheme have been appropriately trained for their role.

Currently there is a legionella risk control scheme in place within these premises. It is essential that this is fully implemented to reduce the actual legionella risk associated with the water systems on this site. The proposed schedule of monitoring activities is provided in the Legionella Monitoring Scheme for Domestic Water.

Remote Monitoring (RM) is currently active on this site.

All incoming mains water supply distribution temperatures were considered satisfactory for legionella control at the time of the assessment, at below 20°C.

All hot water outlets achieved at least 50°C within 1 minute; this is adequate for Legionella control.

Calorifiers were found to be heating the water to or in excess of the minimum required temperature of 60°C. It was further noted that the recirculation temperature was or in excess of the minimum required temperature of 50°C. Although temperatures were found to be adequate, the system was found to be out of balance at the extreme points of the building.

Diaphragm/bladder expansion vessels were identified on site. Diaphragm/bladder expansion vessels represent potential deadlegs within which stagnant water can accumulate thereby creating an environment that is more favourable for microbial growth. It is essential then that such expansion vessels are fitted with a drain valve to allow the vessel to be flushed and that flushing is undertaken on at least a six-monthly basis.

Flexible pipework was noted as being present on various outlets. Low quality non-WRAS approved flexible pipework has been previously identified as harbouring and supporting the proliferation of contaminating micro-organisms. Clarification is required over whether this flexible pipework is WRAS approved.

Scale was noted on a number of outlets. Scale can harbour and provide nourishment for contaminating micro-organisms. The scale should be removed completely with regular inspections and cleaning thereafter.

Aerators/Flow Straightener inserts were noted on a number of outlets. These can create greater potential for aerosol production during normal use and have also been identified as harbouring small droplets of water within which bacteria can proliferate. Consideration should be given to their removal.

A number of showers were identified. As showers produce significantly more aerosols, the most common vector for Legionella transmission, this type of outlet must be inspected quarterly and descaled and disinfected when required.

A number of temperature mixing valves have been installed on site. Whilst these valves assist in blending water to minimise the potential for users being scalded, they can harbour and provide a favourable environment for microbial growth. It is essential that these valves are inspected and maintained on an annual basis.

Introduction

The presence of connected "Quick fill loops" for heating/chilled systems was observed. Disconnect the quick fill when not in use to prevent the potential of stagnant water contaminating the domestic water system. If a dead leg is created, then it will require flushing on a weekly basis and recorded within the logbook.

Refer to table 3.1 Remedial Action to Water Systems for further details.

The risk assessment has been carried out with an asset register provided by HBE.

Water systems found at Donnini House Sheltered Housing, Easington Colliery, Peterlee are captured in table *4.1 Overview of Water Systems*.

1.4 Allocation of Risk Rating

Items of plant constituting a risk to health have an Inherent Risk and an Actual Risk. The aim of a complete Risk Assessment is to firstly identify all plant with an inherent risk and then make an assessment of its actual risk.

In making a valued assessment of the actual risk condition of the plant, maintenance procedures, location, compliance with current guidelines and codes of practice should all be examined.

Inherent Risk Rating

Each risk assessment should be accompanied by an explanation of the inherent risk, with the actual risk reported and based on the grading system below. This should enable the responsible person to prioritise future actions.

Minimal Risk	Low Risk	Medium Risk	High Risk	Very High Risk

In general terms the following broad categories may apply:

i.	<u>Very High Risk System:</u>	A very high risk system is one where high aerosol release such as cooling water systems and spa baths if found.
ii.	<u>High Risk System:</u>	A high aerosol generation systems such as showers, spray booths, fountains and humidifiers if found.
iii.	<u>Medium Risk System:</u>	Stored water systems such as cold water storage tanks, calorifiers, combination water heaters if found.
iv.	<u>Low Risk System:</u>	Mains water systems, with minimal storage and without aerosol generators if found.
v.	<u>Minimal Risk System:</u>	Mains water systems, without storage and without aerosol generators if found.

Risk Type	Risk Rating
Inherent risk	Low Risk

Actual Risk

Accompanying each section of the assessment should be the recommendations to minimise the actual risk, these may involve changes to the plant and upgrading maintenance regimes and documentation procedures amongst others. The conclusions and recommendations contained in this assessment are based upon information supplied by the Site's responsible person and/or his/her deputies.

	Very High Risk / Category 1 To be completed as soon as reasonably practicable
	High Risk / Category 2 To be completed as soon as reasonably practicable
	Medium Risk / Category 3 Implementation within 6 months
	Low Risk / Category 4 Implement within 12 months
	Minimal Risk / Category 5 To be completed during next plant shut down or where budgetary restrictions allow.

Should further information subsequently become available which may impact on this assessment, a review of the assessment may be required.

This report has determined the risk rating from the water systems below. The scoring takes into account factors such as severity of plant present, persons exposed, the written scheme, system condition and any relevant training.

This highlights the importance of effective *HSG 274 / L8 based* and *HPSC* risk management programme. In the case of Donnini House Sheltered Housing, Easington Colliery, Peterlee the risk is managed by implementation of an *HSG 274 / L8* and *HPSC* monitoring programs for water systems.

Risk Factors	Risk Rating
Population Vulnerability Potential	Medium
Aerosol Exposure Risk	Medium
Proliferation Risk	Low
Management of the water systems	Low

Asset Type	Risk Rating
Calorifiers CAL 1	Low
Calorifiers CAL 2	Low
External / Internal Utility Water Taps EUT1	High
External / Internal Utility Water Taps EUT2	Low
External / Internal Utility Water Taps EUT3	Low
Flexible Hose Connectors Flexible Hose Connectors	Low
Flexible Hose Connectors Flexible Hose Connectors	Medium
Mains water supply MAINS 1	Low
Mains water supply MAINS 2	Low
Pressurisation Unit PU1	Low
Expansion / Pressure Vessels / Pump Accumulators PV1	Low
Expansion / Pressure Vessels / Pump Accumulators PV2	Low
Quick Fill Loops QFL1	Low
Showers Shower	Low
Scale on Taps SOT1	Medium
TMVs TMV 1	Low
TMVs TMV 10	Low
TMVs TMV 11	Low
TMVs TMV 12	Low
TMVs TMV 13	Low

Asset Type	Risk Rating
TMVs TMV 14	Low
TMVs TMV 15	Low
TMVs TMV 16	Low
TMVs TMV 17	Low
TMVs TMV 18	Low
TMVs TMV 19	Low
TMVs TMV 2	Low
TMVs TMV 20	Low
TMVs TMV 3	Low
TMVs TMV 4	Low
TMVs TMV 5	Low
TMVs TMV 6	Low
TMVs TMV 7	Low
TMVs TMV 8	Low
TMVs TMV 9	Low
Kitchen Equipment Washing Machine	Low
Kitchen Equipment Washing Machine x 2	Low

RA Review Within	Risk Rating
2 year	Medium

It is recommended that this site be reviewed no later than 07/11/2025.

1.5 Scope and Application of Risk Assessment

HBE have been contracted by Believe Housing to carry out a comprehensive Legionella and Water Hygiene Risk Assessment on domestic water systems within Donnini House Sheltered Housing, Easington Colliery, Peterlee. The Building is currently in use.

Carleton Waite of HBE conducted this Risk Assessment on the 7 Nov 2023. Carleton Waite has completed Legionella specific training such as the WMSoc, City & Guilds and BOHS P901. HBE ensure, through appropriate training, that surveyors have the appropriate instruction, information, resources and equipment to carry out risk assessments in a competent and safe manner. Certification for training is included in the appendices of this report.

Site should ensure that suitable control measures are in place and that all recommendations are completed to ensure that the risk from all systems is controlled.

Limitations of Survey

Although every care is taken to detect all relevant pipe work and systems on site, it is possible that some elements may remain hidden from inspection (e.g. dead legs and underground pipes) and shall be detailed in the executive summary.

This Risk Assessment is the considered opinion of the consultant involved, based on the evidence found at the time of inspection, and covers only the systems and facilities listed within.

Since supply water quality, weather conditions and several other factors will vary over the course of time and as a result of seasonal changes, the findings of this study and resultant recommendations should be taken in the context of the current situation. Future conditions may lead to the establishment of significantly different risk levels.


Neither HBE nor its representatives are qualified to offer any medical opinion regarding Legionella based diseases or the likely effects of any particular level of bacteria on site.

NOTE

Any property that has a prolonged shutdown (greater than 1 week) must ensure that a weekly flushing programme is implemented to replicate normal water usage. i.e. school closed during summer holidays or sports pavilions during off season.

1.6 Risk Assessment Handover

HBE have provided an independent assessment to this customer, and have highlighted the requirements and recommendations to control the risk from Legionella. It is the responsibility of the customer to ensure the full implementation of all remedial work and recommendations on site.

HBE Legionella Risk Assessor Signature
Carleton Waite 
Legionella Risk Assessor Name
Date: 7th November 2023

The record of the assessment is a living document that should be reviewed to ensure it remains up-to-date. Arrange to review the assessment regularly and specifically whenever there is reason to suspect it is no longer valid. An indication of when to review the assessment and what to consider should be recorded.

This may result from, e.g.:

- (a) Changes to the water system or its use;
- (b) Changes to the use of the building in which the water system is installed;
- (c) The availability of new information about risks or control measures;
- (d) The results of checks indicating that control measures are no longer effective;
- (e) Changes to key personnel;
- (f) A case of legionnaires' disease/legionellosis associated with the system.

See ACOP, L8 (Fourth edition) Para 47 and HPSC, Legionella Guidelines 2009, Chapter 5.

2 Overview of Site

2.1 Site Details

Building use:	Sheltered Accommodation
Frequency of use:	Daily

Occupancy Levels

Number of Occupants and Potential Contractors:	100
Is Building Open to General Public?	Yes
Susceptible Groups:	<p>Present</p> <p>While previously healthy people may develop legionnaires' disease, there are a number of factors, which increase susceptibility:</p> <ul style="list-style-type: none"> • Increasing age, particularly above 45 years; • Newborn infants; • Gender: males are three times more likely to be infected than females; • Existing respiratory disease which makes lungs more vulnerable to infection; • Illnesses, such as cancer, diabetes, kidney disease or alcoholism, which weaken the natural defences; • Smoking, particularly heavy cigarette smoking, because of the probability of impaired lung function; • Patients on renal dialysis or immune-suppressant drugs, which inhibit the body's natural defences against infection. <p>While the above risk groups may not be present on this site it is vital for the Health and Safety of all occupants, visitors and residents that risk systems are operated in a manner which reduces any potential risk as outlined in this survey.</p>

2.2 Lines of Communication

Inadequate management, lack of training and poor communication have all been identified as contributory factors in outbreaks of Legionnaires' disease. This is particularly important where several people are responsible for different aspects of the treatment or precautions.

Legislative Requirements

If you are an employer or a person with responsibilities for control of premises, you are defined as the dutyholder and you have legal responsibilities for the health and safety of employees and non-employees affected by your work activities.

The principal legislation that applies are the (UK) Health and Safety at Work etc. Act 1974, COSHH 2002 and the Management of Health and Safety at Work Regulations 1999; (NI) The Health and Safety at Work Order 1978, COSHH 2003 and The Management of Health and Safety at Work Regulations 2000, Statutory Instrument (S.I) The Safety, Health and Welfare at Work Act No. 10 of 2005, At Work (General Applications) No. 299 of 2007, At Work (Chemical Agents) No. 619/2001, At Work (Biological Agents) No. 572 of 2013, At Work (Reporting of Accidents and Dangerous Occurrences) No. 370 of 2016.

Responsibilities

The ACoP / HPSC states that, if you are the dutyholder, to comply with your legal duties you should:

- Identify and assess sources of risk in a written risk assessment
- Appoint a person to be managerially responsible for the water system
- Prepare a written scheme for preventing or controlling the risk
- Implement and manage precautions
- Keep records of the precautions

In addition, the ACoP / HPSC sets out the responsibilities of suppliers of services such as water treatment and maintenance as well as manufacturers, importers and installers.

In law you are not required to do everything that is contained in the ACoP / HPSC but you should do all that is reasonably practicable to eliminate or control a foreseeable risk of people being exposed to Legionella bacteria within an aerosol. If you fail to follow the guidance in the ACoP and accompanying HSG274 / HPSC or do not implement equivalent control measures you are likely to be subject to enforcement action by the HSE / HSA or your local Environmental Health Officer. You do not have to cause cases of Legionnaires' disease to be liable for prosecution under the HSWA or COSHH. You can be prosecuted for failing to implement reasonable measures to prevent or control the risk or because of a failure of the control measures that could lead to exposure to Legionella bacteria.

Communications should be 'fail-safe'. The record system is the method to ensure that precautions continue to be carried out and that information is available for checking what is done in practice.

ACOP L8 (Fourth edition) Paragraphs 48 - 51 and HPSC, Legionella Guidelines 2009 Chapter 5 highlights the requirement for identified lines of communication and a clear structure of responsibility, which should be put in place to ensure competent management of the risk management program.

Risk Rating	
Management and Written Scheme Risk Rating	Low

Overview of Site

Duty Holder: The person on whom the statutory duty falls. The duty holder has overall responsibility for the Legionella program and should appoint a responsible person to supervise the day to day running of all Legionella related issues (*ACOP L8 (Fourth edition), Para 48*) and *HPSC, Legionella Guidelines 2009, Chapter 5*).

Name	Alan Smith
Position	Position Chief Executive
Telephone Number	0300 1311 999
Mobile Number	07894838649
E-mail address	alan.smith@believehousing.co.uk

Responsible Person: Appointed by the statutory duty holder. The responsible person is charged with responsibility for implementing the risk assessment recommendations and the Legionella risk management program. The responsible person reports to the duty holder (*ACOP L8 (Fourth edition), Para 51*) and *HPSC, Legionella Guidelines 2009, Chapter 5*).

Name	Emma Jorgenson
Position	Compliance Manager
Telephone Number	0191 814 2900
Mobile Number	07384 523636
E-mail address	emma.jorgenson@believehousing.co.uk

Deputy Responsible Person: Appointed by the statutory duty holder or responsible person. The deputy responsible person is charged with responsibility for implementing the risk assessment recommendations and the Legionella risk management program in the absence of the responsible person.

Name	Andrew Graham
Position	Compliance Officer
Telephone Number	03001 311999
Mobile Number	07901 510712
E-mail address	andrew.graham@believehousing.co.uk

Site Contact: Appointed by the responsible person. Point of contact between site and water treatment specialists/consultants. Involved in the day to day running of the risk management program. Person nominated by site to give assistance and information on day of survey.

Name	Andrew Graham
Position	Compliance Officer
Telephone Number	03001 311999
Mobile Number	07901 510712
E-mail address	andrew.graham@believehousing.co.uk

Overview of Site

Water Treatment Company: Appointed by the duty holder. The water treatment company provides information on current legislation and industry best practice in relation to Legionella. May also be required by site to implement management programmes, provide chemical dosing programmes and technical support.

Company Name

Name	HBE UK & Ireland
System Involved	Domestic
Telephone Number	0333 207 5744
Mobile Number	N/A
E-mail address	http://enquiries@hberm.com/

Water Hygiene Consultants: Appointed by the duty holder/water treatment company to complete the Legionella risk assessment on site. The water hygiene consultant provides information on current legislation and industry best practice in relation to Legionella. May also be required by site to implement management programmes, provide chemical dosing programmes and technical support.

HBE Account Manager

Name	Lloyd Neary
Position	Account Manager
Telephone Number	0845 6399673
Mobile Number	07885 969616
E-mail address	l.neary@hberm.com

HBE Legionella Risk Assessor

Name	Carleton Waite
Position	Legionella Risk Assessor
Telephone Number	
Mobile Number	07515993281
E-mail address	carleton.waite@hberm.com

Lines of Communication Information Received From

Name	Andrew Graham
Position	Compliance Officer

Cooling Water System Records/Information Received From

Name	N/A
Position	N/A

Leisure Centre Information Received From

Name	N/A
Position	N/A

Legionella Monitoring Scheme - Domestic Water

Where a scheme of control is in place, HBE risk assessors shall undertake a detailed appraisal and audit of the scheme and report on its adequacy. In order to ensure that the risks from legionella are controlled, *HSG 274 Part 2 and HPSC, Legionella Guidelines 2009* recommends that a programme of checks, inspections and monitoring of the risk systems be put in place. Detailed below are these tasks and their scheduled frequencies for domestic water systems. Where this survey has found that an item is not completed, or completed at an inadequate frequency, site shall implement remedial action to ensure the appropriate checks and tests are in place for an adequate system of control, as recommended by *HSG 274 Part 2 Table 2.1* and *HPSC, Legionella Guidelines 2009, Table 4*.

Details are specified in the table below. Any actions required by site are detailed in Section 3.

Action	Frequency	Currently Carried Out On Recommended Interval
Flush of Infrequently Used Outlets	Weekly	Contractor
Measure Temperature of Sentinel Outlets Cold / Hot	Monthly	Contractor
Measure Temperature of Calorifier / PHE Flow	Monthly	Contractor
Measure Temperature of Calorifier / PHE Return	Monthly	Contractor
TMV Sentinel Temperature Checks	Monthly	Contractor
Flushing of Expansion Vessels	Monthly	Contractor
Descale Clean and Disinfect Shower Heads (Inc. Spray nozzles on IWH)	Quarterly	Contractor
Inspection and servicing of TMV's	Annually	Contractor
Measure Temperature of Incoming Mains	Annually	Contractor
Measure Temperature of Representative Selected Outlets	Annually	Contractor
Flush Calorifier Drain to Indicate Internal Condition	Annually	Contractor
Internal Inspection of Calorifier	Annually	Contractor
Review Meeting With Customer	Annually	Client
Clean and Disinfect Calorifier (Remedial Action)	Annually	No
Review Results	Annually	Client

Inspection of Record Systems - Domestic Water

An assessment of the risk should be carried out and those appointed shall record the significant findings and ensure appropriate records are kept as highlighted in *ACOP L8 (fourth edition)* and *HPSC, Legionella Guidelines 2009*. This should include any groups of employees identified as being particularly at risk and the steps taken to prevent or control risks. If the employer has less than five employees there is no statutory duty to write anything down, but it may be useful to keep a written record of what has been done.

Item	Information	Satisfactory Yes/No	Reference Source
Management Structure / Lines Of Communication	Do persons responsible for water hygiene and safety have responsibilities detailed in writing?	Yes	Electronic Records Held
Suitable Record Keeping	Are records relating to water hygiene and control scheme documents located centrally?	Yes	Electronic Records Held
Written Control Scheme In Place	Is there a written control scheme in place and implemented fully?	Yes	Electronic Records Held
Where System Drawings Available – Where Are They Located	Are schematic drawings available?	Yes	Current Risk Assessment
Site Visits And Inspections	Are site visits relating to water hygiene logged?	Yes	Electronic Records Held
Cleaning And Disinfection Records	Are disinfection records held on site?	Yes	Electronic Records Held
Training Records Of Personnel	Are training records held on site?	Yes	Electronic Records Held
Training Records For All Positions	Are duty holders training to the standards required? Are staff involved in water hygiene trained to standards required?	Yes	Electronic Records Held
Training Records For Third Party	Are training records held on site?	Yes	Electronic Records Held
Remedial Work Completed And Recorded	Are records kept of any remedial works on site?	Yes	Electronic Records Held
Legionella Risk Assessment	Has a risk assessment been carried out previously?	Yes	Electronic Records Held
Safe Operation Of Risk Systems	Are systems that pose substantial risk operated safely and documentation located on site?	Yes	Electronic Records Held
Water Safety Plan/Policy And Escalation Procedures	Is there a water safety policy created for this site? Is there an adequate written escalation plan to ensure that during an outbreak at this site, or site nearby, that appropriate persons and government bodies are contacted and media and communication requirements covered?	Yes	Electronic Records Held
Calibration Records For Monitoring Thermometers	If site carries out temperature monitoring themselves, do site calibrate their thermometers?	Yes	Temperature Monitoring Contracted

3 Recommendations and Requirements

3.1 Remedial Action to Water Systems

The recommendations of the risk assessment are itemised below. This log should be used to monitor and maintain a signed record of the completion of all recommendations made in the Legionella Risk Assessment. This log should be completed by a person of suitable authority i.e. Duty Holder, Responsible Person or other nominated personnel.

Priority Rating Key:

1. Very High Risk - To be completed as soon as reasonably practicable
2. High Risk - To be completed as soon as reasonably practicable
3. Medium Risk - Implementation within 6 months
4. Low Risk - Implement within 12 months
5. Minimal Risk - To be completed during next plant shut down or where budgetary restrictions allow

System Ref	Calorifiers	Priority	Assigned To	Comments	Date Completed	Signed
CAL 1	Repair and replace corroded pipework on the return	High / Category 2				

System Ref	General	Priority	Assigned To	Comments	Date Completed	Signed
EUT1	The correct WRAS approved bib taps should be fitted to meet fluid category risk where there is a possibility that hoses being used can cause back flow contamination.	High / Category 2				

System Ref	General	Priority	Assigned To	Comments	Date Completed	Signed
Flexible Hose Connectors	At the time of the survey the WRAS approved numbers could not be identified on the flexible hoses, site shall ensure that these are compliant and either replace or pipe in rigid copper.	Medium / Category 3				

System Ref	General	Priority	Assigned To	Comments	Date Completed	Signed
------------	---------	----------	-------------	----------	----------------	--------

Recommendations and Requirements

SOT1	Site should clean, disinfect and descale taps which are affected on a quarterly basis. This frequency can be reviewed depending on condition of the outlets.	Medium / Category 3				
------	--	---------------------	--	--	--	--

System Ref	TMV Details	Priority	Assigned To	Comments	Date Completed	Signed
TMV 17	Site shall ensure that safe access is granted to all parts of the system for risk assessment purposes.	High / Category 2				

This risk assessment was conducted by HBE. Whilst every effort has been made to ensure that the assessment has been as comprehensive as possible, it should be recognised that it is impossible to guarantee that every system has been identified and so no liability can be accepted for omissions from this report. Diligence should be maintained in regarding the potential risk of all water systems. If a system is identified which has a potential for harbouring Legionella bacteria, for which no precautions are currently detailed, then HBE should be contacted with a view to advising on the implementation of suitable procedures and updating the risk assessment.

©2020 HBE.

4 Appraisal of Water Systems

4.1 Overview of Water Systems

It is believed that this list is comprehensive, however it should be recognised that it is impossible to guarantee that every system has been identified. It is from inspection of the systems described below that the comments and recommendations in Section 3.1 are made.

Mains Water System

Asset No.	Location	Serving
MAINS 2	GF - Bin Store	Building
MAINS 1	External - Boiler Room	Boiler Room

Calorifiers

Asset No.	Location	No. of Calorifiers in system	Fed From	Serving
CAL 1	External - Boiler Room	2	Mains	Building
CAL 2	External - Boiler Room	2	Mains	Building

Sentinel Outlet Identification

Supplied from	Sentinel	Location/System Ref
CAL 1	NH - Nearest Hot	1st - Flat 20 (RM), .
	FH - Furthest Hot	GF - Flat 6 (RM), .
MAINS 1	NC - Nearest Cold	1st - Flat 20 (RM), .
	FC - Furthest Cold	GF - Flat 6 (RM), .

Domestic Showers & Wash Outlets

Asset No.	Location	Hot Supply	Cold Supply	Number of Outlets
Shower	External - Flat 1	-	Mains	1
Shower	GF - Shower	-	Mains	1
Shower	1st - Shower Room	-	Mains	1
Shower	Flat 21	-	Mains	1
Shower	Flat 2	Cals 1/2	Mains	1
Shower	Flat 3	Cals 1/2	Mains	1
Shower	Flat 5	Cals 1/2	Mains	1
Shower	Flat 6	Cals 1/2	Mains	1
Shower	Flat 4	Cals 1/2	Mains	1
Shower	Flat 9	Cals 1/2	Mains	1
Shower	Flat 10	Cals 1/2	Mains	1
Shower	Flat 11	Cals 1/2	Mains	1
Shower	Flat 13	Cals 1/2	Mains	1
Shower	Flat 14	Cals 1/2	Mains	1
Shower	Flat 17	Cals 1/2	Mains	1
Shower	Flat 20	Cals 1/2	Mains	1
Shower	Flat 25	Cals 1/2	Mains	1

Appraisal of Water Systems

Shower	Flat 27	Cals 1/2	Mains	1
--------	---------	----------	-------	---

Thermostatic Mixing Valves

Asset No.	Location	Hot Supply	Cold Supply	Approximate Number
TMV 1	GF - Female WC	Cal 1/2	Mains	1
TMV 2	GF - Accessible WC	Cal 1/2	Mains	1
TMV 3	GF - Shower	Cal 1/2	Mains	1
TMV 4	1st - Shower Room	Cal 1/2	Mains	1
TMV 5	1st - Guest Room	Cal 1/2	Mains	1
TMV 6	Flat 2	Cals 1/2	Mains	1
TMV 7	Flat 3	Cals 1/2	Mains	1
TMV 8	Flat 5	Cals 1/2	Mains	1
TMV 9	Flat 6	Cals 1/2	Mains	1
TMV 10	Flat 7	Cals 1/2	Mains	1
TMV 11	Flat 4	Cals 1/2	Mains	1
TMV 12	Flat 9	Cals 1/2	Mains	1
TMV 13	Flat 10	Cals 1/2	Mains	1
TMV 14	Flat 11	Cals 1/2	Mains	1
TMV 15	Flat 13	Cals 1/2	Mains	1
TMV 16	Flat 14	Cals 1/2	Mains	1
TMV 17	Flat 17	Mains	Cals 1/2	1
TMV 18	Flat 20	Cals 1/2	Mains	1
TMV 19	Flat 25	Cals 1/2	Mains	1
TMV 20	Flat 27	Cals 1/2	Mains	1

Other Water System on Site

Asset No.	Location	System Type	Fed From
Washing Machine	External - Flat 1	Kitchen Equipment	Mains
EUT1	External - Garden	External / Internal Utility Water Taps	Mains
Washing Machine x 2	GF - Laundry	Kitchen Equipment	Mains/Cal 1/2
EUT2	GF - Bin Store	External / Internal Utility Water Taps	Mains
PV1	External - Boiler Room	Expansion / Pressure Vessels / Pump Accumulators	Mains
PV2	External - Boiler Room	Expansion / Pressure Vessels / Pump Accumulators	Mains
PU1	External - Boiler Room	Pressurisation Unit	Mains
QFL1	External - Boiler Room	Quick Fill Loops	Mains
EUT3	External - Boiler Room	External / Internal Utility Water Taps	Mains
SOT1	Site Wide	Scale on Taps	Domestic
Flexible Hose Connectors	Flat 2	Flexible Hose Connectors	Domestic

Appraisal of Water Systems

Flexible Hose Connectors	GF - Accessible WC	Flexible Hose Connectors	Domestic
Flexible Hose Connectors	Flat 3	Flexible Hose Connectors	Domestic
Flexible Hose Connectors	Flat 5	Flexible Hose Connectors	Domestic
Flexible Hose Connectors	Flat 13	Flexible Hose Connectors	Domestic
Flexible Hose Connectors	Flat 13	Flexible Hose Connectors	Domestic
Flexible Hose Connectors	Flat 20	Flexible Hose Connectors	Domestic
Flexible Hose Connectors	Flat 25	Flexible Hose Connectors	Domestic
Flexible Hose Connectors	1st - Guest Room	Flexible Hose Connectors	Domestic

Hot and Cold Water Outlets

Location
Refer to the schematic drawing for full location of hot and cold water outlets

Water Source

The water supply to a premises normally presents a low legionella risk due to the temperature of the incoming water which is generally well below control temperature. Even though legionella is a naturally occurring bacterium in the water, the relatively low temperature will render the bacteria dormant.

However, if the water supply is from an unusual source, for example a bore hole, natural wells, rain water harvesting system or even natural water bodies such as rivers and streams these may have the potential to contain debris and other factors could make bacterial proliferation a problem.

The investigation of any filtration systems and chemical treatment along with temperature profiling should give a good indicator of the risk of legionella.

Water source details are specified in the table below. Any actions required by site are detailed in Section 3.

Appraisal of Water Systems

	Asset No.	MAINS 2
	Location	GF - Bin Store
Details	Mains Supply Stop Cock Location	Bin Store
	Serving Building	Building
	Mains Supply Source	Local Water Board
Material of Construction	Water Treatment In Place	N/A
	Temperature Of Mains Supply	13°C
	Supply Pipework	Plastic
	Distribution Pipework	Copper
	Incoming Pipework Insulated	Yes
	Strainer Fitted	N/A
	Strainer Fitted Correctly	N/A
	Water Meter Installed	U/D
	Drinking Water Outlets Labelled	N/A
	WRAS Approved Materials	Yes
Records	Chemical Dosing System	N/A
	Filtration System	N/A
	UV System	N/A

Risk Rating	
System Risk	Low



Appraisal of Water Systems

	Asset No.	MAINS 1
	Location	External - Boiler Room
Details	Mains Supply Stop Cock Location	Boiler Room
	Serving	Boiler Room
	Mains Supply Source	Local Water Board
Material of Construction	Water Treatment In Place	N/A
	Temperature Of Mains Supply	10°C
	Supply Pipework	Plastic
	Distribution Pipework	Copper
	Incoming Pipework Insulated	Yes
	Strainer Fitted	N/A
	Strainer Fitted Correctly	N/A
	Water Meter Installed	U/D
	Drinking Water Outlets Labelled	N/A
	WRAS Approved Materials	Yes
Records	Chemical Dosing System	N/A
	Filtration System	N/A
	UV System	N/A

Risk Rating	
System Risk	Low



Calorifier

Calorifiers present a low legionella risk, however when the calorifier supplies other associated plant which may have a high risk potential (e.g. showers etc.), the potential risk from such calorifiers is significantly higher.

Poor control over the water temperature and condition of the calorifier are the most significant factors in determining the risk presented by hot water calorifiers to the down water services.

Hot water systems details are specified in the table below. Any actions required by site are detailed in Section 3.

Asset No.	CAL 1
Location	External - Boiler Room
CAL Details	
Supplied from	Mains
Serving Building	Building
Time Of Inspection	10:00
Make and Model	Lochinvar
Calorifier Orientation	Vertical
No of Calorifiers in System	2
Materials Of Construction	Stainless Steel
Capacity	374.0ltrs
Main Heat Source	Gas
Supplementary Heat Source	-
Temp & Flow	
Temperature Gauge Fitted To Calorifier / Flow	Yes
Temperature Gauge Fitted To Return	Yes
Calorifier Off Or On	On
Flow Temperature	63.0°C
Return Temperature	61.0°C
Calorifier Stratification	No
Calorifier Temperature Top	N/A
Calorifier Temperature Middle	N/A
Calorifier Temperature Bottom	N/A
Thermostat Setting	63°C
Drain Fitted	Yes
Complete Draining Of Vessel Possible	Yes
Initial Blow down Appearance	Unable To Determine
Circulation & Insulation	
System Circulated	Yes
Pumps Alternated	N/A
Calorifier Insulation	Yes
Pipe Work Insulation	Yes
Pipe Work labelled	Yes
Open Vent Present	N/A
Safety Valve Present	Yes
Shunt Pump Fitted	N/A
Other Info	
WRAS Approved Materials	Yes
Suitable Capacity For System	Yes
Inspection Hatch Present	N/A
Suitable Access Present	Yes
Temperatures	NH 64.0°C FH 61.0°C

Risk Rating	
System Risk	Low



Appraisal of Water Systems

Asset No.	CAL 2
Location	External - Boiler Room
CAL Details	
Supplied from	Mains
Serving Building	Building
Time Of Inspection	10:00
Make and Model	Lochinvar
Calorifier Orientation	Vertical
No of Calorifiers in System	2
Materials Of Construction	Stainless Steel
Capacity	374.0ltrs
Main Heat Source	Gas
Supplementary Heat Source	-
Temp & Flow	
Temperature Gauge Fitted To Calorifier / Flow	Yes
Temperature Gauge Fitted To Return	Yes
Calorifier Off Or On	On
Flow Temperature	66.0°C
Return Temperature	61.0°C
Calorifier Stratification	No
Calorifier Temperature Top	N/A
Calorifier Temperature Middle	N/A
Calorifier Temperature Bottom	N/A
Thermostat Setting	66°C
Drain Fitted	Yes
Complete Draining Of Vessel Possible	Yes
Initial Blow down Appearance	Unable To Determine
Circulation & Insulation	
System Circulated	Yes
Pumps Alternated	N/A
Calorifier Insulation	Yes
Pipe Work Insulation	Yes
Pipe Work labelled	Yes
Open Vent Present	N/A
Safety Valve Present	Yes
Shunt Pump Fitted	N/A
Other Info	
WRAS Approved Materials	Yes
Suitable Capacity For System	Yes
Inspection Hatch Present	N/A
Suitable Access Present	Yes

Risk Rating	
System Risk	Low



Domestic Showers & Wash Outlets

As showers and spray outlets produce fine water droplets they present a significantly higher risk for the development of Legionnaires' disease than other types of hot and cold outlets. The most significant factors in determining the risk potential are water temperature, showerhead design, frequency of use and the cleanliness of the outlet.

Showers supplied via storage tanks, blending valves and temperature mixing valves pose greater risk of bacteria proliferation due to the design of the pipework with stagnated water stored in pipework prior to mixing.

Mains supplied electrical showers present a significantly lower risk of population by bacteria and dispersion due to the water source for this type of outlet. Although an aerosol is produced, the temperature of the water source should render any legionella bacteria dormant.

Shower details are specified in the table below. Any actions required by site are detailed in Section 3.

	Asset No.	Shower
	Location	External - Flat 1
SH Details	Number of Outlets	1
	Fed From Hot	-
	Fed From Cold	Mains
	Type Of Shower	Electric
Unit Type	Fixed Head	No
	Hose And Handset Type	Yes
	Connected To Bath	N/A
TMV Arrangement	Accessible	N/A
	At Each Individual Shower	N/A
	Supplying Multiple Showers	N/A
Showerhead Condition	Scale Present	No
	Algae Growth Present	No
	Usage - Frequently	Yes

Risk Rating	
System Risk	Low



Appraisal of Water Systems

	Asset No.	Shower
	Location	GF - Shower
SH Details	Number of Outlets	1
	Fed From Hot	-
	Fed From Cold	Mains
	Type Of Shower	Electric
Unit Type	Fixed Head	No
	Hose And Handset Type	Yes
	Connected To Bath	N/A
TMV Arrangement	Accessible	N/A
	At Each Individual Shower	N/A
	Supplying Multiple Showers	N/A
Showerhead Condition	Scale Present	No
	Algae Growth Present	No
	Usage - Frequently	Yes

Risk Rating	
System Risk	Low



Appraisal of Water Systems

	Asset No.	Shower
	Location	1st - Shower Room
SH Details	Number of Outlets	1
	Fed From Hot	-
	Fed From Cold	Mains
	Type Of Shower	Electric
Unit Type	Fixed Head	No
	Hose And Handset Type	Yes
	Connected To Bath	N/A
TMV Arrangement	Accessible	N/A
	At Each Individual Shower	N/A
	Supplying Multiple Showers	N/A
Showerhead Condition	Scale Present	No
	Algae Growth Present	No
	Usage - Frequently	Yes

Risk Rating	
System Risk	Low



Appraisal of Water Systems

	Asset No.	Shower
	Location	Flat 21
SH Details	Number of Outlets	1
	Fed From Hot	-
	Fed From Cold	Mains
	Type Of Shower	Electric
Unit Type	Fixed Head	No
	Hose And Handset Type	Yes
	Connected To Bath	N/A
TMV Arrangement	Accessible	N/A
	At Each Individual Shower	N/A
	Supplying Multiple Showers	N/A
Showerhead Condition	Scale Present	No
	Algae Growth Present	No
	Usage - Frequently	Yes

Risk Rating	
System Risk	Low



	Asset No.	Shower
	Location	Flat 2
SH Details	Number of Outlets	1
	Fed From Hot	Cals 1/2
	Fed From Cold	Mains
	Type Of Shower	Thermostatic
Unit Type	Fixed Head	No
	Hose And Handset Type	Yes
	Connected To Bath	N/A
TMV Arrangement	Accessible	N/A
	At Each Individual Shower	N/A
	Supplying Multiple Showers	N/A
Showerhead Condition	Scale Present	No
	Algae Growth Present	No
	Usage - Frequently	Yes

Risk Rating	
System Risk	Low



	Asset No.	Shower
	Location	Flat 3
SH Details	Number of Outlets	1
	Fed From Hot	Cals 1/2
	Fed From Cold	Mains
	Type Of Shower	Thermostatic
Unit Type	Fixed Head	No
	Hose And Handset Type	Yes
	Connected To Bath	N/A
TMV Arrangement	Accessible	N/A
	At Each Individual Shower	N/A
	Supplying Multiple Showers	N/A
Showerhead Condition	Scale Present	No
	Algae Growth Present	No
	Usage - Frequently	Yes

Risk Rating	
System Risk	Low



Appraisal of Water Systems

	Asset No.	Shower
	Location	Flat 5
SH Details	Number of Outlets	1
	Fed From Hot	Cals 1/2
	Fed From Cold	Mains
	Type Of Shower	Thermostatic
Unit Type	Fixed Head	No
	Hose And Handset Type	Yes
	Connected To Bath	N/A
TMV Arrangement	Accessible	N/A
	At Each Individual Shower	N/A
	Supplying Multiple Showers	N/A
Showerhead Condition	Scale Present	No
	Algae Growth Present	No
	Usage - Frequently	Yes

Risk Rating	
System Risk	Low



	Asset No.	Shower
	Location	Flat 6
SH Details	Number of Outlets	1
	Fed From Hot	Cals 1/2
	Fed From Cold	Mains
	Type Of Shower	Thermostatic
Unit Type	Fixed Head	No
	Hose And Handset Type	Yes
	Connected To Bath	N/A
TMV Arrangement	Accessible	N/A
	At Each Individual Shower	N/A
	Supplying Multiple Showers	N/A
Showerhead Condition	Scale Present	No
	Algae Growth Present	No
	Usage - Frequently	Yes

Risk Rating	
System Risk	Low



Appraisal of Water Systems

	Asset No.	Shower
	Location	Flat 4
SH Details	Number of Outlets	1
	Fed From Hot	Cals 1/2
	Fed From Cold	Mains
	Type Of Shower	Thermostatic
Unit Type	Fixed Head	No
	Hose And Handset Type	Yes
	Connected To Bath	N/A
TMV Arrangement	Accessible	N/A
	At Each Individual Shower	N/A
	Supplying Multiple Showers	N/A
Showerhead Condition	Scale Present	No
	Algae Growth Present	No
	Usage - Frequently	Yes

Risk Rating	
System Risk	Low



	Asset No.	Shower
	Location	Flat 9
SH Details	Number of Outlets	1
	Fed From Hot	Cals 1/2
	Fed From Cold	Mains
	Type Of Shower	Thermostatic
Unit Type	Fixed Head	Yes
	Hose And Handset Type	No
	Connected To Bath	N/A
TMV Arrangement	Accessible	N/A
	At Each Individual Shower	N/A
	Supplying Multiple Showers	N/A
Showerhead Condition	Scale Present	No
	Algae Growth Present	No
	Usage - Frequently	Yes

Risk Rating	
System Risk	Low



	Asset No.	Shower
	Location	Flat 10
SH Details	Number of Outlets	1
	Fed From Hot	Cals 1/2
	Fed From Cold	Mains
	Type Of Shower	Thermostatic
Unit Type	Fixed Head	No
	Hose And Handset Type	Yes
	Connected To Bath	N/A
TMV Arrangement	Accessible	N/A
	At Each Individual Shower	N/A
	Supplying Multiple Showers	N/A
Showerhead Condition	Scale Present	No
	Algae Growth Present	No
	Usage - Frequently	Yes


Risk Rating	
System Risk	Low



Appraisal of Water Systems

	Asset No.	Shower
	Location	Flat 11
SH Details	Number of Outlets	1
	Fed From Hot	Cals 1/2
	Fed From Cold	Mains
	Type Of Shower	Thermostatic
Unit Type	Fixed Head	No
	Hose And Handset Type	Yes
	Connected To Bath	N/A
TMV Arrangement	Accessible	N/A
	At Each Individual Shower	N/A
	Supplying Multiple Showers	N/A
Showerhead Condition	Scale Present	No
	Algae Growth Present	No
	Usage - Frequently	Yes

Risk Rating	
System Risk	Low

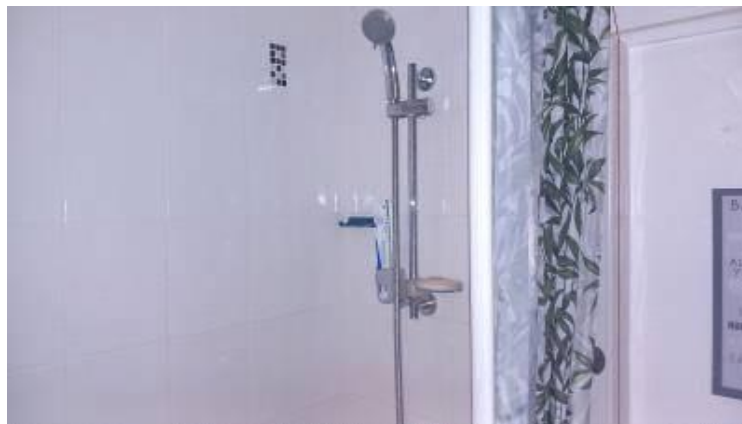

	Asset No.	Shower
	Location	Flat 13
SH Details	Number of Outlets	1
	Fed From Hot	Cals 1/2
	Fed From Cold	Mains
	Type Of Shower	Thermostatic
Unit Type	Fixed Head	No
	Hose And Handset Type	Yes
	Connected To Bath	N/A
TMV Arrangement	Accessible	N/A
	At Each Individual Shower	N/A
	Supplying Multiple Showers	N/A
Showerhead Condition	Scale Present	No
	Algae Growth Present	No
	Usage - Frequently	Yes


Risk Rating	
System Risk	Low



Appraisal of Water Systems

	Asset No.	Shower
	Location	Flat 14
SH Details	Number of Outlets	1
	Fed From Hot	Cals 1/2
	Fed From Cold	Mains
	Type Of Shower	Thermostatic
Unit Type	Fixed Head	No
	Hose And Handset Type	Yes
	Connected To Bath	N/A
TMV Arrangement	Accessible	N/A
	At Each Individual Shower	N/A
	Supplying Multiple Showers	N/A
Showerhead Condition	Scale Present	No
	Algae Growth Present	No
	Usage - Frequently	Yes

Risk Rating	
System Risk	Low

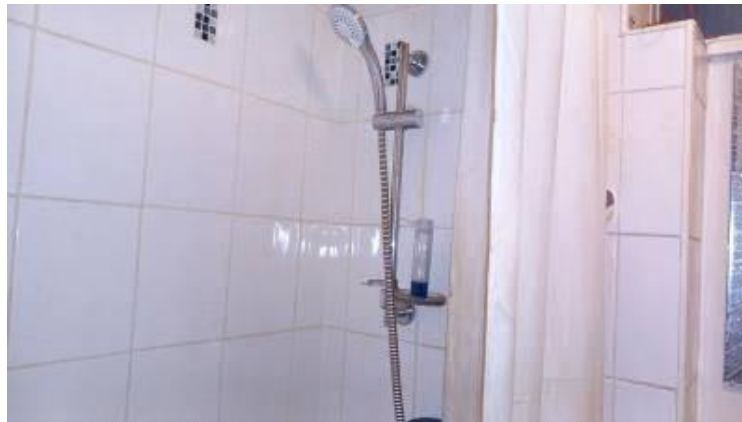

Appraisal of Water Systems

	Asset No.	Shower
	Location	Flat 17
SH Details	Number of Outlets	1
	Fed From Hot	Cals 1/2
	Fed From Cold	Mains
	Type Of Shower	Thermostatic
Unit Type	Fixed Head	No
	Hose And Handset Type	Yes
	Connected To Bath	N/A
TMV Arrangement	Accessible	N/A
	At Each Individual Shower	N/A
	Supplying Multiple Showers	N/A
Showerhead Condition	Scale Present	No
	Algae Growth Present	No
	Usage - Frequently	Yes


Risk Rating	
System Risk	Low



Appraisal of Water Systems

	Asset No.	Shower
	Location	Flat 20
SH Details	Number of Outlets	1
	Fed From Hot	Cals 1/2
	Fed From Cold	Mains
	Type Of Shower	Thermostatic
Unit Type	Fixed Head	No
	Hose And Handset Type	Yes
	Connected To Bath	N/A
TMV Arrangement	Accessible	N/A
	At Each Individual Shower	N/A
	Supplying Multiple Showers	N/A
Showerhead Condition	Scale Present	No
	Algae Growth Present	No
	Usage - Frequently	Yes

Risk Rating	
System Risk	Low

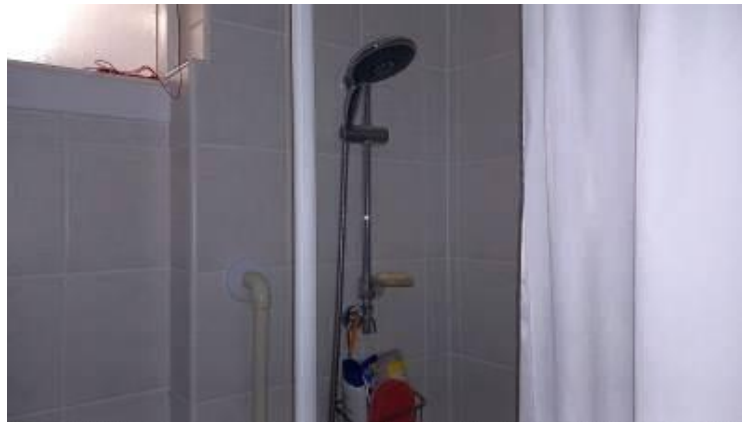

Appraisal of Water Systems

	Asset No.	Shower
	Location	Flat 25
SH Details	Number of Outlets	1
	Fed From Hot	Cals 1/2
	Fed From Cold	Mains
	Type Of Shower	Thermostatic
Unit Type	Fixed Head	No
	Hose And Handset Type	Yes
	Connected To Bath	N/A
TMV Arrangement	Accessible	N/A
	At Each Individual Shower	N/A
	Supplying Multiple Showers	N/A
Showerhead Condition	Scale Present	No
	Algae Growth Present	No
	Usage - Frequently	Yes

Risk Rating	
System Risk	Low



Appraisal of Water Systems

	Asset No.	Shower
	Location	Flat 27
SH Details	Number of Outlets	1
	Fed From Hot	Cals 1/2
	Fed From Cold	Mains
	Type Of Shower	Thermostatic
Unit Type	Fixed Head	No
	Hose And Handset Type	Yes
	Connected To Bath	N/A
TMV Arrangement	Accessible	N/A
	At Each Individual Shower	N/A
	Supplying Multiple Showers	N/A
Showerhead Condition	Scale Present	No
	Algae Growth Present	No
	Usage - Frequently	Yes

Risk Rating	
System Risk	Low



Thermostatic Mixing Valves

TMVs use a temperature sensitive element to blend hot and cold water to produce water at a temperature that safeguards against the risk of scalding. The mixed temperatures are typically set between 38°C and 46°C depending on outlet use. The blended water downstream of TMVs may provide an environment in which legionella can multiply, thus increasing the risks of exposure.

Where TMVs are fitted, consideration should be given to the following factors:

- where practicable, TMVs should be incorporated directly in the tap fitting as mixing at the point of outlet is preferable;
- the risk is increased where TMVs are fitted with low flow rate spray taps on hand washbasins;
- TMV valves should be as close to the POU as possible to minimise the storage of blended water;
- the risk can also be increased where a single TMV serves multiple tap outlets.

TMV details are specified in the table below. Any actions required by site are detailed in Section 3.

	Asset No.	TMV 1
	Location	GF - Female WC
TMV Details	Approximate Number	1
	TMV Type	TMV
	Fed from Hot	Cal 1/2
	Fed from Cold	Mains
	Accessible	Yes
	At Each Individual Outlet	Yes
	Supplying Multiple Outlets	No
	Number of outlets	1
Temperature	Hot Supply To TMV Temperature	61.0°C
	Cold Supply To TMV Temperature	14.0°C
	Nearest Non-TMV Tap- Max Hot Temperature	N/A
	Nearest Non-TMV Tap- Max Cold Temperature	N/A
	TMV Outlet Temperature	39.0°C
	Can TMV be moved closer to the POU	No
	Can TMV be removed from system	No

Risk Rating	
System Risk	Low



	Asset No.	TMV 2
	Location	GF - Accessible WC
TMV Details	Approximate Number	1
	TMV Type	TMV
	Fed from Hot	Cal 1/2
	Fed from Cold	Mains
	Accessible	Yes
	At Each Individual Outlet	Yes
	Supplying Multiple Outlets	No
	Number of outlets	1
Temperature	Hot Supply To TMV Temperature	60.0°C
	Cold Supply To TMV Temperature	15.0°C
	Nearest Non-TMV Tap- Max Hot Temperature	N/A
	Nearest Non-TMV Tap- Max Cold Temperature	N/A
	TMV Outlet Temperature	38.0°C
	Can TMV be moved closer to the POU	No
	Can TMV be removed from system	No

Risk Rating	
System Risk	Low



	Asset No.	TMV 3
	Location	GF - Shower
TMV Details	Approximate Number	1
	TMV Type	TMV
	Fed from Hot	Cal 1/2
	Fed from Cold	Mains
	Accessible	Yes
	At Each Individual Outlet	Yes
	Supplying Multiple Outlets	No
	Number of outlets	1
Temperature	Hot Supply To TMV Temperature	62.0°C
	Cold Supply To TMV Temperature	14.0°C
	Nearest Non-TMV Tap- Max Hot Temperature	N/A
	Nearest Non-TMV Tap- Max Cold Temperature	N/A
	TMV Outlet Temperature	42.0°C
	Can TMV be moved closer to the POU	No
	Can TMV be removed from system	No

Risk Rating	
System Risk	Low



	Asset No.	TMV 4
	Location	1st - Shower Room
TMV Details	Approximate Number	1
	TMV Type	TMV
	Fed from Hot	Cal 1/2
	Fed from Cold	Mains
	Accessible	Yes
	At Each Individual Outlet	Yes
	Supplying Multiple Outlets	No
	Number of outlets	1
Temperature	Hot Supply To TMV Temperature	63.0°C
	Cold Supply To TMV Temperature	14.0°C
	Nearest Non-TMV Tap- Max Hot Temperature	N/A
	Nearest Non-TMV Tap- Max Cold Temperature	N/A
	TMV Outlet Temperature	42.0°C
	Can TMV be moved closer to the POU	No
	Can TMV be removed from system	No

Risk Rating	
System Risk	Low



Asset No.	TMV 5
Location	1st - Guest Room
TMV Details	
Approximate Number	1
TMV Type	TMV
Fed from Hot	Cal 1/2
Fed from Cold	Mains
Accessible	Yes
At Each Individual Outlet	Yes
Supplying Multiple Outlets	No
Number of outlets	1
Temperature	
Hot Supply To TMV Temperature	62.0°C
Cold Supply To TMV Temperature	14.0°C
Nearest Non-TMV Tap- Max Hot Temperature	N/A
Nearest Non-TMV Tap- Max Cold Temperature	N/A
TMV Outlet Temperature	38.0°C
Can TMV be moved closer to the POU	No
Can TMV be removed from system	No

Risk Rating	
System Risk	Low



	Asset No.	TMV 6
	Location	Flat 2
TMV Details	Approximate Number	1
	TMV Type	TMV
	Fed from Hot	Cals 1/2
	Fed from Cold	Mains
	Accessible	Yes
	At Each Individual Outlet	Yes
	Supplying Multiple Outlets	No
	Number of outlets	1
Temperature	Hot Supply To TMV Temperature	61°C
	Cold Supply To TMV Temperature	12°C
	Nearest Non-TMV Tap- Max Hot Temperature	N/A
	Nearest Non-TMV Tap- Max Cold Temperature	N/A
	TMV Outlet Temperature	40°C
	Can TMV be moved closer to the POU	No
	Can TMV be removed from system	No

Risk Rating	
System Risk	Low



Appraisal of Water Systems

	Asset No.	TMV 7
	Location	Flat 3
TMV Details	Approximate Number	1
	TMV Type	TMV
	Fed from Hot	Cals 1/2
	Fed from Cold	Mains
	Accessible	Yes
	At Each Individual Outlet	Yes
	Supplying Multiple Outlets	No
	Number of outlets	1
Temperature	Hot Supply To TMV Temperature	59°C
	Cold Supply To TMV Temperature	13°C
	Nearest Non-TMV Tap- Max Hot Temperature	N/A
	Nearest Non-TMV Tap- Max Cold Temperature	N/A
	TMV Outlet Temperature	42°C
	Can TMV be moved closer to the POU	No
	Can TMV be removed from system	No

Risk Rating	
System Risk	Low



	Asset No.	TMV 8
	Location	Flat 5
TMV Details	Approximate Number	1
	TMV Type	TMV
	Fed from Hot	Cals 1/2
	Fed from Cold	Mains
	Accessible	Yes
	At Each Individual Outlet	Yes
	Supplying Multiple Outlets	No
	Number of outlets	1
Temperature	Hot Supply To TMV Temperature	60°C
	Cold Supply To TMV Temperature	13°C
	Nearest Non-TMV Tap- Max Hot Temperature	N/A
	Nearest Non-TMV Tap- Max Cold Temperature	N/A
	TMV Outlet Temperature	40°C
	Can TMV be moved closer to the POU	No
	Can TMV be removed from system	No

Risk Rating	
System Risk	Low



	Asset No.	TMV 9
	Location	Flat 6
TMV Details	Approximate Number	1
	TMV Type	TMV
	Fed from Hot	Cals 1/2
	Fed from Cold	Mains
	Accessible	Yes
	At Each Individual Outlet	Yes
	Supplying Multiple Outlets	No
	Number of outlets	1
Temperature	Hot Supply To TMV Temperature	61°C
	Cold Supply To TMV Temperature	13°C
	Nearest Non-TMV Tap- Max Hot Temperature	N/A
	Nearest Non-TMV Tap- Max Cold Temperature	N/A
	TMV Outlet Temperature	39°C
	Can TMV be moved closer to the POU	No
	Can TMV be removed from system	No

Risk Rating	
System Risk	Low



	Asset No.	TMV 10
	Location	Flat 7
TMV Details	Approximate Number	1
	TMV Type	TMV
	Fed from Hot	Cals 1/2
	Fed from Cold	Mains
	Accessible	Yes
	At Each Individual Outlet	Yes
	Supplying Multiple Outlets	No
	Number of outlets	1
Temperature	Hot Supply To TMV Temperature	62°C
	Cold Supply To TMV Temperature	13°C
	Nearest Non-TMV Tap- Max Hot Temperature	N/A
	Nearest Non-TMV Tap- Max Cold Temperature	N/A
	TMV Outlet Temperature	39°C
	Can TMV be moved closer to the POU	No
	Can TMV be removed from system	No

Risk Rating	
System Risk	Low



	Asset No.	TMV 11
	Location	Flat 4
TMV Details	Approximate Number	1
	TMV Type	TMV
	Fed from Hot	Cals 1/2
	Fed from Cold	Mains
	Accessible	Yes
	At Each Individual Outlet	Yes
	Supplying Multiple Outlets	No
	Number of outlets	1
Temperature	Hot Supply To TMV Temperature	60°C
	Cold Supply To TMV Temperature	12°C
	Nearest Non-TMV Tap- Max Hot Temperature	N/A
	Nearest Non-TMV Tap- Max Cold Temperature	N/A
	TMV Outlet Temperature	38°C
	Can TMV be moved closer to the POU	No
	Can TMV be removed from system	No

Risk Rating	
System Risk	Low



	Asset No.	TMV 12
	Location	Flat 9
TMV Details	Approximate Number	1
	TMV Type	TMV
	Fed from Hot	Cals 1/2
	Fed from Cold	Mains
	Accessible	Yes
	At Each Individual Outlet	Yes
	Supplying Multiple Outlets	No
	Number of outlets	1
Temperature	Hot Supply To TMV Temperature	58°C
	Cold Supply To TMV Temperature	13°C
	Nearest Non-TMV Tap- Max Hot Temperature	N/A
	Nearest Non-TMV Tap- Max Cold Temperature	N/A
	TMV Outlet Temperature	41°C
	Can TMV be moved closer to the POU	No
	Can TMV be removed from system	No

Risk Rating	
System Risk	Low



	Asset No.	TMV 13
	Location	Flat 10
TMV Details	Approximate Number	1
	TMV Type	TMV
	Fed from Hot	Cals 1/2
	Fed from Cold	Mains
	Accessible	Yes
	At Each Individual Outlet	Yes
	Supplying Multiple Outlets	No
	Number of outlets	1
Temperature	Hot Supply To TMV Temperature	61°C
	Cold Supply To TMV Temperature	12°C
	Nearest Non-TMV Tap- Max Hot Temperature	N/A
	Nearest Non-TMV Tap- Max Cold Temperature	N/A
	TMV Outlet Temperature	40°C
	Can TMV be moved closer to the POU	No
	Can TMV be removed from system	No

Risk Rating	
System Risk	Low




	Asset No.	TMV 14
	Location	Flat 11
TMV Details	Approximate Number	1
	TMV Type	TMV
	Fed from Hot	Cals 1/2
	Fed from Cold	Mains
	Accessible	Yes
	At Each Individual Outlet	Yes
	Supplying Multiple Outlets	No
	Number of outlets	1
Temperature	Hot Supply To TMV Temperature	60°C
	Cold Supply To TMV Temperature	13°C
	Nearest Non-TMV Tap- Max Hot Temperature	N/A
	Nearest Non-TMV Tap- Max Cold Temperature	N/A
	TMV Outlet Temperature	42°C
	Can TMV be moved closer to the POU	No
	Can TMV be removed from system	No

Risk Rating	
System Risk	Low



	Asset No.	TMV 15
	Location	Flat 13
TMV Details	Approximate Number	1
	TMV Type	TMV
	Fed from Hot	Cals 1/2
	Fed from Cold	Mains
	Accessible	Yes
	At Each Individual Outlet	Yes
	Supplying Multiple Outlets	No
	Number of outlets	1
Temperature	Hot Supply To TMV Temperature	58°C
	Cold Supply To TMV Temperature	12°C
	Nearest Non-TMV Tap- Max Hot Temperature	N/A
	Nearest Non-TMV Tap- Max Cold Temperature	N/A
	TMV Outlet Temperature	39°C
	Can TMV be moved closer to the POU	No
	Can TMV be removed from system	No

Risk Rating	
System Risk	Low

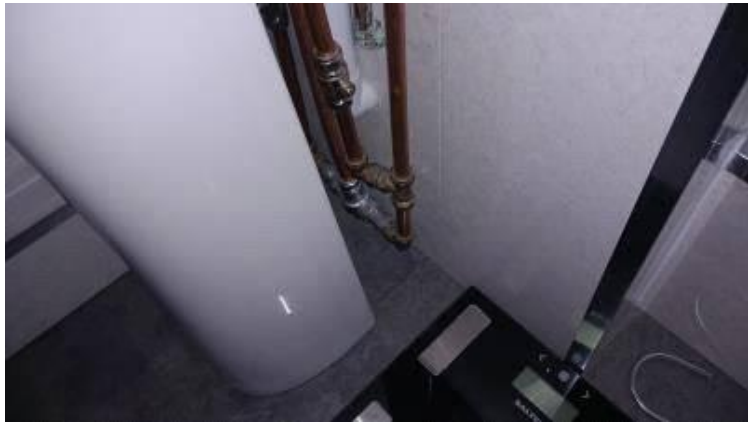

	Asset No.	TMV 16
	Location	Flat 14
TMV Details	Approximate Number	1
	TMV Type	TMV
	Fed from Hot	Cals 1/2
	Fed from Cold	Mains
	Accessible	Yes
	At Each Individual Outlet	Yes
	Supplying Multiple Outlets	No
	Number of outlets	1
Temperature	Hot Supply To TMV Temperature	60°C
	Cold Supply To TMV Temperature	13°C
	Nearest Non-TMV Tap- Max Hot Temperature	N/A
	Nearest Non-TMV Tap- Max Cold Temperature	N/A
	TMV Outlet Temperature	42°C
	Can TMV be moved closer to the POU	No
	Can TMV be removed from system	No

Risk Rating	
System Risk	Low



	Asset No.	TMV 17
	Location	Flat 17
TMV Details	Approximate Number	1
	TMV Type	TMV
	Fed from Hot	Mains
	Fed from Cold	Cals 1/2
	Accessible	No
	At Each Individual Outlet	Yes
	Supplying Multiple Outlets	No
	Number of outlets	1
Temperature	Hot Supply To TMV Temperature	
	Cold Supply To TMV Temperature	
	Nearest Non-TMV Tap- Max Hot Temperature	N/A
	Nearest Non-TMV Tap- Max Cold Temperature	N/A
	TMV Outlet Temperature	40°C
	Can TMV be moved closer to the POU	No
	Can TMV be removed from system	No

Risk Rating	
System Risk	Low



	Asset No.	TMV 18
	Location	Flat 20
TMV Details	Approximate Number	1
	TMV Type	TMV
	Fed from Hot	Cals 1/2
	Fed from Cold	Mains
	Accessible	Yes
	At Each Individual Outlet	Yes
	Supplying Multiple Outlets	No
	Number of outlets	1
Temperature	Hot Supply To TMV Temperature	59°C
	Cold Supply To TMV Temperature	12°C
	Nearest Non-TMV Tap- Max Hot Temperature	N/A
	Nearest Non-TMV Tap- Max Cold Temperature	N/A
	TMV Outlet Temperature	39°C
	Can TMV be moved closer to the POU	No
	Can TMV be removed from system	No

Risk Rating	
System Risk	Low



	Asset No.	TMV 19
	Location	Flat 25
TMV Details	Approximate Number	1
	TMV Type	TMV
	Fed from Hot	Cals 1/2
	Fed from Cold	Mains
	Accessible	Yes
	At Each Individual Outlet	Yes
	Supplying Multiple Outlets	No
	Number of outlets	1
Temperature	Hot Supply To TMV Temperature	59°C
	Cold Supply To TMV Temperature	13°C
	Nearest Non-TMV Tap- Max Hot Temperature	N/A
	Nearest Non-TMV Tap- Max Cold Temperature	N/A
	TMV Outlet Temperature	42°C
	Can TMV be moved closer to the POU	No
	Can TMV be removed from system	No

Risk Rating	
System Risk	Low



	Asset No.	TMV 20
	Location	Flat 27
TMV Details	Approximate Number	1
	TMV Type	TMV
	Fed from Hot	Cals 1/2
	Fed from Cold	Mains
	Accessible	Yes
	At Each Individual Outlet	Yes
	Supplying Multiple Outlets	No
	Number of outlets	1
Temperature	Hot Supply To TMV Temperature	60°C
	Cold Supply To TMV Temperature	13°C
	Nearest Non-TMV Tap- Max Hot Temperature	N/A
	Nearest Non-TMV Tap- Max Cold Temperature	N/A
	TMV Outlet Temperature	39°C
	Can TMV be moved closer to the POU	No
	Can TMV be removed from system	No

Risk Rating	
System Risk	Low



Pressurisation Unit

The mains water supply to this pressurisation unit is infrequently required and potentially a dead leg. Consideration should be given to fitting a WRAS approved double check valve on the mains supply line to this tank as close to the mains header as possible.

Pressurisation unit details are specified in the table below. Any actions required by site are detailed in Section 3.

Appraisal of Water Systems

	Asset No.	PU1
	Location	External - Boiler Room
Pressurisation Unit	Serving	Heating
	Fed From	Mains
	Check Valve Installed	Yes
	Ball Valve Submerged	No
	Materials Of Construction	Steel

Risk Rating	
System Risk	Low



External / Internal Utility Water Taps


It is recommended that hose pipes used in conjunction with taps are removed after use and not left connected to the outlets as this can result in back contamination of the water system. Flexible hoses provide good conditions for bacterial growth so pipe interrupters should be fitted to all taps where there is the possibility that hoses will be used.

Utility Water Tap details are specified in the table below. Any actions required by site are detailed in Section 3.

Appraisal of Water Systems

	Asset No.	EUT1
	Location	External - Garden
General	Satisfactory	No
Fed From	Fed From	Mains
	Comments	-

Risk Rating	
System Risk	High

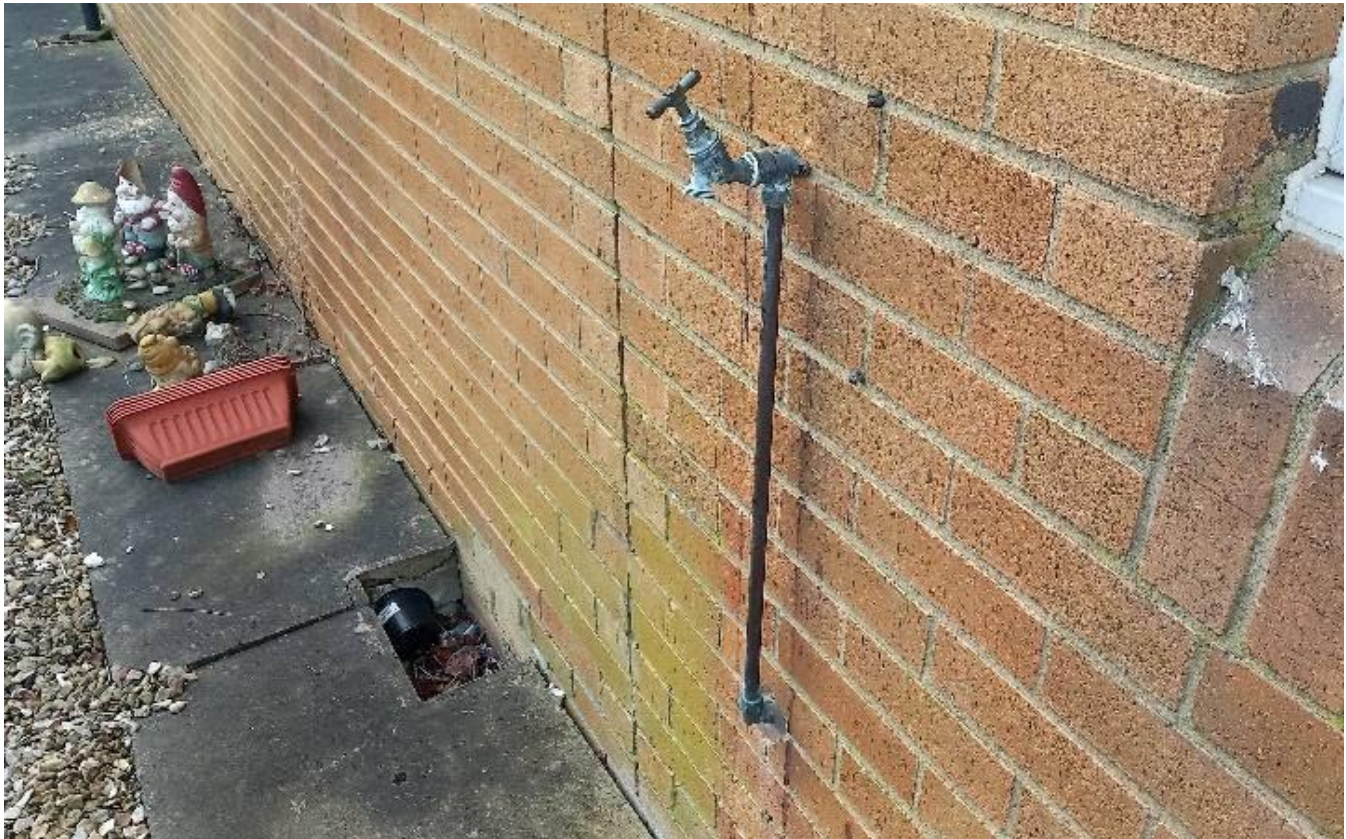

Appraisal of Water Systems

	Asset No.	EUT2
	Location	GF - Bin Store
General	Satisfactory	Yes
Fed From	Fed From	Mains
	Comments	-

Risk Rating	
System Risk	Low



Appraisal of Water Systems

	Asset No.	EUT3
	Location	External - Boiler Room
General	Satisfactory	Yes
Fed From	Fed From	Mains
	Comments	-

Risk Rating	
System Risk	Low



Flexible Hose Connectors

Some materials such as polyethylene and ethylene-propylene found in under sink flexible hoses encourage colonisation and biofilm formation by a wide range of bacteria. Avoid materials that harbour bacteria and other micro-organisms, or provide nutrients for microbial growth. All materials used in the construction of systems should comply with the WRAS requirements or byelaws.

Flexible hose connectors details are specified in the table below. Any actions required by site are detailed in Section 3.

Appraisal of Water Systems

	Asset No.	Flexible Hose Connectors
	Location	Flat 2
General	Satisfactory	No
Fed From	Fed From	Domestic
	Comments	-

Risk Rating	
System Risk	Medium



Appraisal of Water Systems

	Asset No.	Flexible Hose Connectors
	Location	GF - Accessible WC
General	Satisfactory	No
Fed From	Fed From	Domestic
	Comments	-

Risk Rating	
System Risk	Medium



Appraisal of Water Systems

	Asset No.	Flexible Hose Connectors
	Location	Flat 3
General	Satisfactory	Yes
Fed From	Fed From	Domestic
	Comments	-

Risk Rating	
System Risk	Low



Appraisal of Water Systems

	Asset No.	Flexible Hose Connectors
	Location	Flat 5
General	Satisfactory	Yes
Fed From	Fed From	Domestic
	Comments	-

Risk Rating	
System Risk	Low



Appraisal of Water Systems

	Asset No.	Flexible Hose Connectors
	Location	Flat 13
General	Satisfactory	No
Fed From	Fed From	Domestic
	Comments	-

Risk Rating	
System Risk	Medium



Appraisal of Water Systems

	Asset No.	Flexible Hose Connectors
	Location	Flat 13
General	Satisfactory	No
Fed From	Fed From	Domestic
	Comments	-

Risk Rating	
System Risk	Medium



Appraisal of Water Systems

	Asset No.	Flexible Hose Connectors
	Location	Flat 20
General	Satisfactory	No
Fed From	Fed From	Domestic
	Comments	-

Risk Rating	
System Risk	Medium



Appraisal of Water Systems

	Asset No.	Flexible Hose Connectors
	Location	Flat 25
General	Satisfactory	No
Fed From	Fed From	Domestic
	Comments	-

Risk Rating	
System Risk	Medium



Appraisal of Water Systems

	Asset No.	Flexible Hose Connectors
	Location	1st - Guest Room
General	Satisfactory	No
Fed From	Fed From	Domestic
	Comments	-

Risk Rating	
System Risk	Medium



Expansion / Pressure Vessels / Pump Accumulators

When these units are incorporated into systems a dead leg is created to the pressurisation vessel. To minimise the dead leg created site should ensure the installation of these vessels are as close as possible to the system pipework.

Expansion and pressure vessel details are specified in the table below. Any actions required by site are detailed in Section 3.

Appraisal of Water Systems

	Asset No.	PV1
	Location	External - Boiler Room
General	Satisfactory	Yes
Fed From	Fed From	Mains
	Comments	-

Risk Rating	
System Risk	Low



Appraisal of Water Systems

	Asset No.	PV2
	Location	External - Boiler Room
General	Satisfactory	Yes
Fed From	Fed From	Mains
	Comments	-

Risk Rating	
System Risk	Low



Scale on Taps

Scale was identified on some taps and this can act as a nutrient source for legionella bacteria.

Scale on tap details are specified in the table below. Any actions required by site are detailed in Section 3.

Appraisal of Water Systems

	Asset No.	SOT1
	Location	Site Wide
General	Satisfactory	No
Fed From	Fed From	Domestic
	Comments	-

Risk Rating	
System Risk	Medium



Quick Fill Loops

Heating and chilled water system quick filling loops should be disconnected when not in use. These are a temporary filling link between mains and closed systems.

Quick fill loop details are specified in the table below. Any actions required by site are detailed in Section 3.

Appraisal of Water Systems

	Asset No.	QFL1
	Location	External - Boiler Room
General	Satisfactory	Yes
Fed From	Fed From	Mains
	Comments	-

Risk Rating	
System Risk	Low



Kitchen Equipment

These systems are generally supplied from the mains and in regular use.

Kitchen equipment details are specified in the table below. Any actions required by site are detailed in Section 3.

Appraisal of Water Systems

	Asset No.	Washing Machine
	Location	External - Flat 1
General	Satisfactory	Yes
Fed From	Fed From	Mains
	Comments	-

Risk Rating	
System Risk	Low



Appraisal of Water Systems

	Asset No.	Washing Machine x 2
	Location	GF - Laundry
General	Satisfactory	Yes
Fed From	Fed From	Mains/Cal 1/2
	Comments	-

Risk Rating	
System Risk	Low



5 Testing of Water Systems

5.1 Water Temperature Measurements

OBJECTIVE To confirm that hot and cold water services are being maintained at temperatures which minimise the risk of proliferation of Legionella bacteria. The aim of the survey is to take a representative number of outlets to give an overall impression of the conditions within the distribution system. All other outlets should operate within the recommended temperature range.

METHOD Measurement of water temperature by the use of an electronic penetration and surface wet probe thermometer. The hot water temperatures recorded from those outlets that are supplied via thermostatic mixing valves (TMV) are taken from the hot and cold flow pipe work before the TMV. This gives the temperature of the water supplied to the TMV.

Where temperature is used as a control method, hot water shall be stored at a minimum of 60°C and distributed so it reaches a minimum temperature of 50°C within one minute at outlets. Where circulation is not possible, trace heating is sometimes used to maintain the water temperature in the spur so that it delivers at 50°C within one minute of running.

Number	Location	Source	Hot °C	S/ NS	Source	Cold °C	S/ NS	CWS >2°C from CWST
1	GF - Kitchen (RM), .	CAL 1	63°C	S	MAINS 1	14°C	S	N/A
2	GF - Flat 6 (RM), .	CAL 1	61°C	S	MAINS 1	15°C	S	N/A
3	1st - Flat 25 (RM), .	CAL 1	64°C	S	MAINS 1	13°C	S	N/A
4	1st - Flat 20 (RM), .	CAL 1	64°C	S	MAINS 1	13°C	S	N/A
5	External - Boiler Room (RM), .	CAL 1	63°C	S			S	N/A
6	External - Boiler Room (RM), .	CAL 2	66°C	S			S	N/A
7	External - Boiler Room (RM), .			S	MAINS 1	13°C	S	N/A
Control parameters –		Cold ≤ 20°C within 2 minutes Hot ≥ 50°C within 1 minute Hot ≥ 50°C within 30 seconds for subordinate loops Hot ≥ 60°C water poses a risk to scalding if no TMV is fitted S = Satisfactory / NS = Not Satisfactory						

6 Appendices

6.1 List of Abbreviations and Acronyms

Standards and methods used in this report are taken from the most appropriate references available. Sources quoted are often given as abbreviations and acronyms and their full names are given here for easy reference.

ug/m ³	microgrammes per cubic metre
BMS	building management system
CAL	calorifier
cfu/l	colony forming units per litre
cfu/ml	colony forming units per millilitre
CHW	chilled water
COSHH	the control of substances hazardous to health regulations
CT	cooling tower
CWH	combination water heater
CWST	cold water storage tank
DCW	domestic cold water
DCWS	domestic cold water system
DHW	domestic hot water
DHWS	domestic hot water system
DE	dead end
DL	dead leg
FC	furthest cold
FH	furthest hot
GRP	glass reinforced plastic
HBE	health built environment
HSWA	the health & safety at work etc. act
IUO	infrequently used outlets
IWH	instant water heater
LPHW	low pressure hot water
mg/m ³	milligrammes per cubic metre
MSDS	material safety data sheets
MW	mains water
NWAM	non wras approved materials
ACS	air conditioning systems
AHU	air handling unit
AS	scrubber system
CD	chlorine dioxide unit
CH	chilled water
CHD	cyclone style hand dryer

DC	dental chairs
EP	exposed pipe work
EUT	utility taps
FCA	fire control systems
FE	feed & expansion tank
FH	flexible hose connectors
FIL	filters
GW	grey water
HE	humidification equipment
INC	incubators
MB	mothballing
MT	lathes / machine tool systems
PAC	portable air conditioning systems
PPW	process production water
PU	pressurisation unit
PV	expansion / pressure vessels / pump accumulators
QFL	quick fill loops
RO	ro unit
RPZ	rpz valves
SOT	scale on taps
SP	swimming pools
SPA	spa baths
ST	spray taps
SPW	spray pressure washers
SR	strainers
SSS	safety shower & emergency eye wash
TSP	tanning spray booths
UV	uv light
VW	vehicle wash
WF	water feature
WP	water purification for dental chairs
WS	water softeners
N/A	not applicable

Appendices

DHCWS	domestic hot & cold water systems
NC	nearest cold
NH	nearest hot
PHE	plate heat exchanger
POU	point of use
ppb	parts per billion
ppm	parts per million
SH	shower/s
TMV	thermostatic mixing valves
TVC	total viable colonies
U/D	undetermined
UKAS	united kingdom accredited service
WH	water heater
WHB	wash hand basin
WMSoc	the water management society
WRAS	water regulations advisory scheme

6.2 Additional Certification



Legionella Control Association
KEEPING WATER SYSTEMS SAFE

Legionella Control Association

A Code of Conduct for Service Providers

Certificate of Registration

This is to certify that the following company has submitted a registration under the Conditions of Compliance as laid out in the LCA's Code of Conduct for Service Providers

Name of Company: HBE

Registration Number: 2008/1339 Certificate valid until: 31st August 2024

Registration under the following services categories:

- (1) Legionella Risk Assessment Services**
 - 1.1 Hot and Cold Water Systems Risk Assessment
 - 1.2 Evaporative Cooling Systems Risk Assessment
 - 1.3 Process and Other Systems Risk Assessment
 - 1.4 Healthcare Risk Assessment
- (2) Water Treatment Services**
 - 2.1 Hot and Cold Water Systems Water Treatment
 - 2.2 Evaporative Cooling Systems Water Treatment
 - 2.3 Process and Other Systems Water Treatment
- (3) Hot and Cold Water Monitoring and Inspection Services**
- (4) Cleaning and Disinfection Services**
 - 4.1 Hot and Cold Water Systems Cleaning and Disinfection
 - 4.2 Evaporative Cooling Systems Cleaning and Disinfection
 - 4.3 Process and Other Systems Cleaning and Disinfection
- (5) Independent Consultancy Services**
- (6) Training Services**
- (7) Legionella Monitoring Services**
 - 7.1 Sampling
 - 7.2 In Field Analysis
 - 7.4 Interpretation of Analysis
- (8) Plant and Equipment Services**
 - 8.1 Design and Supply
 - 8.2 Installation
 - 8.3 Servicing/maintenance
 - 8.4 Refurbishment

This Certificate is only valid if the Company named is listed on the LCA website www.legionellacontrol.org.uk/directory.php



THE WATER MANAGEMENT SOCIETY

Signed: 



Chairman, Executive Committee

Certificate Secretary



British Chemicals Association

Legionella Control Association Limited. www.legionellacontrol.org.uk

Registered in England and Wales No. 8502723

The legal duty to comply with relevant health and safety legislation (including avoidance or control of risk to exposure to Legionella bacteria) rests solely with the statutory dutyholder, being either the employer or the person in control of the premises or systems where any relevant risk is present, and this cannot be delegated. Specific functions (e.g. carrying out risk assessment) can be delegated and the Legionella Control Association (LCA) Code of Conduct is designed to help service providers, who also have duties under health and safety legislation, to establish appropriate management systems for the prevention or control of risk from Legionella bacteria. The LCA assesses the management systems of LCA members upon initial registration, reviews annually upon re-registration, and re-assesses by annual company audits. The LCA cannot and does not carry out other regular supervision of its members' commitments to the Code of Conduct nor their compliance with other LCA guidelines. A valid LCA certificate of registration (which is only valid if the Company named is listed on the LCA website www.legionellacontrol.org.uk/directory.php) confirms only that a service provider has satisfied LCA requirements at registration and its most recent company audit. It does not confirm the service provider's actual or continuing compliance with their commitments to the LCA Code of Conduct and/or other LCA guidelines. The LCA does not approve specific products or services as being effective in controlling Legionella or verify the competence of service providers' staff and sub-contractors, which is the duty of the service provider and the statutory dutyholder. The LCA accepts no liability for any omission or any act carried out in reliance on the LCA Code of Conduct or other LCA guidelines, or any loss or damage resulting from non-compliance with such documents.

6.3 Schematic Drawings

Schematic drawings have been completed as part of the HBE risk assessment; these are attached at the back of the report.

6.4 Legionella Escalation Procedure

Sampling is routinely completed to confirm the effectiveness of the risk management program for Legionella control. A suitably accredited laboratory (UKAS accredited for *Legionella* analysis) completes the laboratory analysis. This provides information on the effectiveness of the control program and indicates whether further assessment of the risk is necessary. More frequent Legionella sampling may be required from areas of high risk, e.g. Elderly Persons Homes, Hospital Wards with High Risk Patients, or other high risk systems such as Cooling Towers or Spa Baths.


For *Legionella* sampling the table below outlines the actions to be taken in accordance with the guidelines laid down in the "HSE document L8 – *Legionnaires' Disease, The control of legionella bacteria in water systems: Approved Code of Practice and Guidance* and HPSC, Health Protection Surveillance Centre, *National Guidelines for the Control of Legionellosis in Ireland 2009 (Please note that this document is not relevant within a healthcare Environment)*.

Legionella Bacteria (cfu/l)	Action
Not Detected	System under control, inform Responsible Person, file results and maintain current control regime.
Up to 100 cfu/l	<p>Inform Responsible Person</p> <p>In healthcare, the primary concern is protecting susceptible patients, so any detection of Legionella must be investigated and, if necessary, the system resampled to aid interpretation of the results in line with the monitoring strategy and risk assessment.</p> <p>File results and record any communication with Responsible Person.</p>
>100 cfu/l and up to 1000 cfu/l	<p>Inform Responsible Person and</p> <p>Either</p> <ul style="list-style-type: none"> • if the minority of samples are positive, the system must be resampled. If similar results are found again, review the control measures and risk assessment to identify any remedial actions necessary or; • if the majority of samples are positive, the system may be colonised, albeit at a low level. An immediate review of control measures and a risk assessment must be carried out to identify any other remedial action required. Disinfection of the system must be considered. <p>File results and record any communication with Responsible Person.</p>
>1000 cfu/l	<p>Inform Responsible Person</p> <p>The system must be resampled and an immediate review of the control measures and risk assessment carried out to identify any remedial actions, including possible disinfection of the system. Retesting must take place a few days after disinfection and at frequent intervals thereafter until a satisfactory level of control is achieved.</p> <p>File results and record any communication with Responsible Person.</p>


6.5 Action to take if there is an outbreak of Legionellosis

1. In England and Wales, legionnaires' disease is notifiable under the Health Protection (Notification) Regulations 2010 and in Scotland under the Public Health (Notification of Infectious Diseases) (Scotland) Regulations 1988 and in Northern Ireland under the Health Protection Agency Order 2007. Under these Regulations, human diagnostic laboratories must notify Public Health England (PHE), Public Health Wales (PHW) or Health Protection Scotland (HPS) and Public Health Agency (PHA) Northern Ireland (see 'Further sources of advice') of microbiologically confirmed cases of legionnaires' disease.
2. An outbreak is defined as two or more cases where the onset of illness is closely linked in time (weeks rather than months) and where there is epidemiological evidence of a common source of infection, with or without microbiological evidence. An incident/outbreak control team must always be convened to investigate outbreaks. It is the responsibility of the Proper Officer to declare an outbreak. The Proper Officer, appointed by the Local Authority, is usually a Consultant in Communicable Diseases Control (CCDC) in England and Wales, or the Consultant in Public Health Medicine (CPHM) in Scotland. If there are suspected cases of the disease, medical practitioners must notify the Proper Officer in the relevant local authority.
3. Local Authorities will have jointly established incident plans to investigate major outbreaks of infectious diseases, including legionellosis, and it is the Proper Officer who activates these and invokes an Outbreak Committee, whose primary purpose is to protect public health and prevent further infection.
4. HSE (UK) or local Environmental Health Officers may be involved in the investigation of outbreaks, their aim being to pursue compliance with health and safety legislation. The local authority, Proper Officer or EHO acting on their behalf will make a visit for public health reasons, often with the relevant officer from the enforcing authorities (i.e. HSE (UK) or the local authority) for health and safety reasons. Any infringements of relevant legislation may be subject to a formal investigation by the appropriate enforcing authority.
5. There are published guidelines (by PHE, PHW and HPS) for the investigation and management of incidents, clusters, and outbreaks of Legionnaires' disease in the community.
6. These are, for England and Wales, Guidance on the Control, and Prevention of Legionnaires' Disease in England and for Scotland, Guidelines on Management of Legionella Incidents, Outbreaks and Clusters in the Community.
7. If a water system is implicated in an outbreak of Legionnaires' disease, emergency treatment of that system must be carried out as soon as possible. This will usually involve the processes detailed in paragraphs 2.124–2.135.
8. In the Republic of Ireland (ROI), the director of public health (DPH)/consultant in public health medicine (CPHM) must:
 - Arrange appropriate epidemiological investigation of a case or outbreak of legionnaires' disease.
 - This must be done in liaison with the clinical microbiologist where one is employed
 - Inform HPSC of a case or outbreak of legionellosis
 - Inform the HSA of a case or outbreak of legionellosis
 - Ensure relevant clinicians and general practitioners (GPs) in the area are informed of a case or outbreak where appropriate.

FIRST FLOOR.

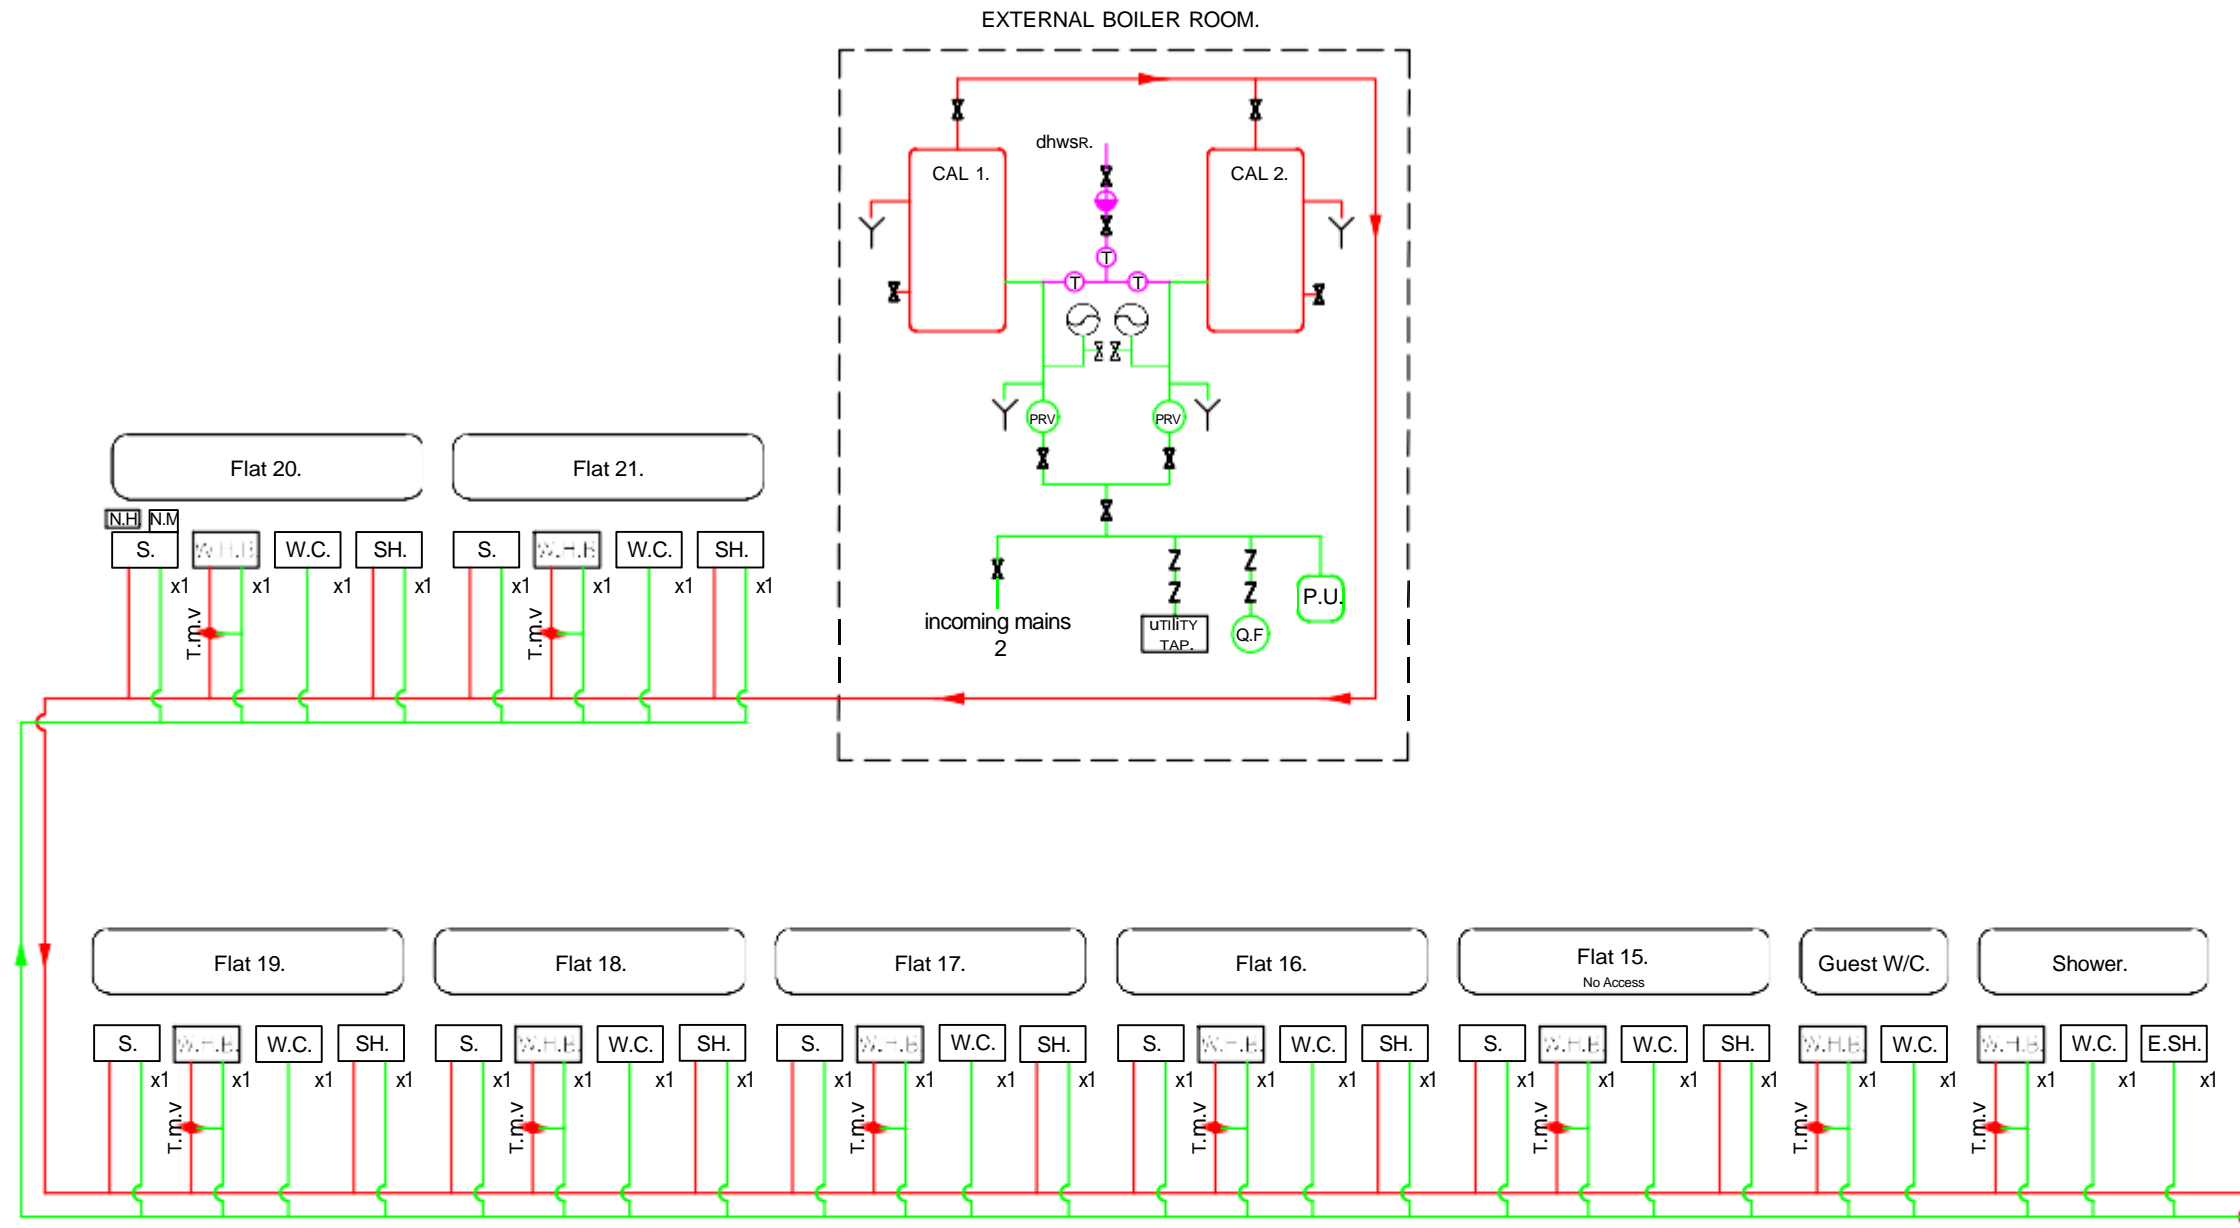

FIRST FLOOR.

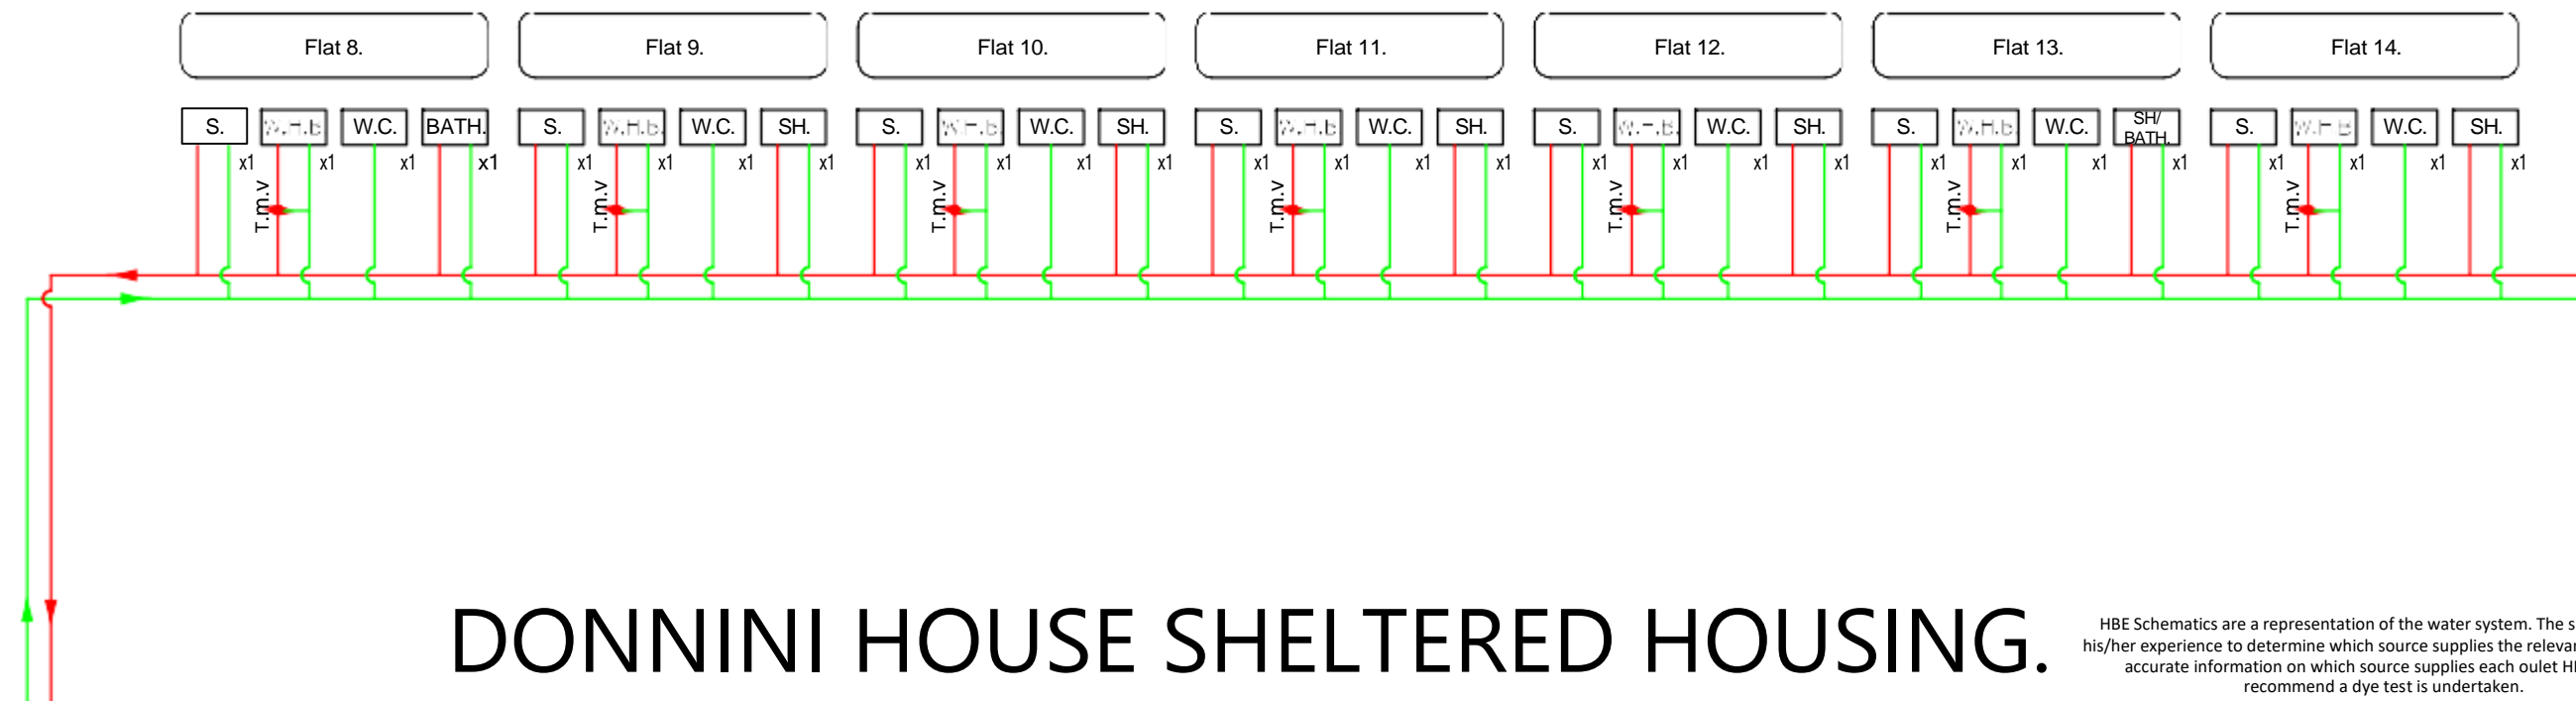


DONNINI HOUSE SHELTERED HOUSING.

HBE Schematics are a representation of the water system. The surveyor uses his/her experience to determine which source supplies the relevant outlet/s. For accurate information on which source supplies each outlet HBE would recommend a dye test is undertaken.

SENTINELS		LEGEND.	
F.H.	FURTHEST HOT.	(RPZ)	REDUCED PRESSURE ZONE
EM	FURTHEST MAINS.	(T)	TEMP GAUGE.
F.C.	FURTHEST COLD.		
N.H.	NEAREST HOT		
N.M.	NEAREST MAINS.		
N.C.	NEAREST COLD.		
M.	METER.	Y	TUNDISH.
L.V.	LID VENT.	⊥	ROBENT SCREEN
S.L.	SECURED LID.	⊥	ISOLATION VALVE.
D.L.	DEAD LEG.	D.E.	DEAD END.
P	PRESSURE GAUGE.	HYDRO	HYDRO BOILER
PV	PRESSURE VESSEL.	⊥	ISOLATION VALVE (OPEN)
PRV	PRESSURE REDUC. VALVE.	⊥	ISOLATION VALVE (CLOSED)
W.H.B.	WASH BASIN.	⊥	PRESSURE REGULATING VALVE
S.	SINK.	⊥	DRAIN LOCK
W.C.	TOILET UNIT.	⊥	RETURN PUMP.
U.	URINAL.	⊥	SHOAT PUMP.
SH.	SHOWER.	⊥	NON-RETURN VALVE
E.SH.	ELECTRIC SHOWER.	⊥	STRAINER.
TAP.	TAP.	⊥	DRINK WATER DISPENSER.
SL.	SLICE SINK.	FLEXI.	FLEXI-HOSE.
D.F.	DRINKING FOUNTAIN.	⊥	CHECK VALVE.
W.M.	WASHING MACHIN.	⊥	DOUBLE CHECK VALVE.
D.W.	DISH WASHER.	PU	PRESSURISATION UNIT.
W.H.	WATER HEATER.	(QF)	QUICK FILL.
I.W.H.	INSTANT WATERHEATER.	D.W.D.	DRINK WATER DISPENSER.
filter	FILTER.	⊥	PRESSURE RELIEF VALVE.
WD SH.	WASH DOWN SHOWER.	⊥	
I.U.O.	INFREQUENTLY USED OUTLET		
EXP.	EXPOSED PIPE WORK		
U/D.	UNDETERMINED		
HEATING ELEMENTS			
(E)	(S)	(G)	
ELECTRICAL	SOLAR	GAS	
—	—	—	
COLD WATER FLOW		HOT WATER FLOW	
—		—	
MAIN WATER FLOW		RETURN WATER FLOW	
▶			
T.M.V.	Thermostatic Mixing Valve	⊥	Thermostatic Mixing Tap
CLIENT: Believe Housing.			
PROJECT: LEGIONELLA RISK ASSESSMENT Eastington Colliery, Peterlee, Durham, SR8 3ER, Great Britain.			
DRAWING: SCHEMATIC LAYOUT. (1 of 2)			
DATE:	HBE REF:	VERSION:	DRAWN BY:
12/23	643228	V2	T.K

GROUND FLOOR.

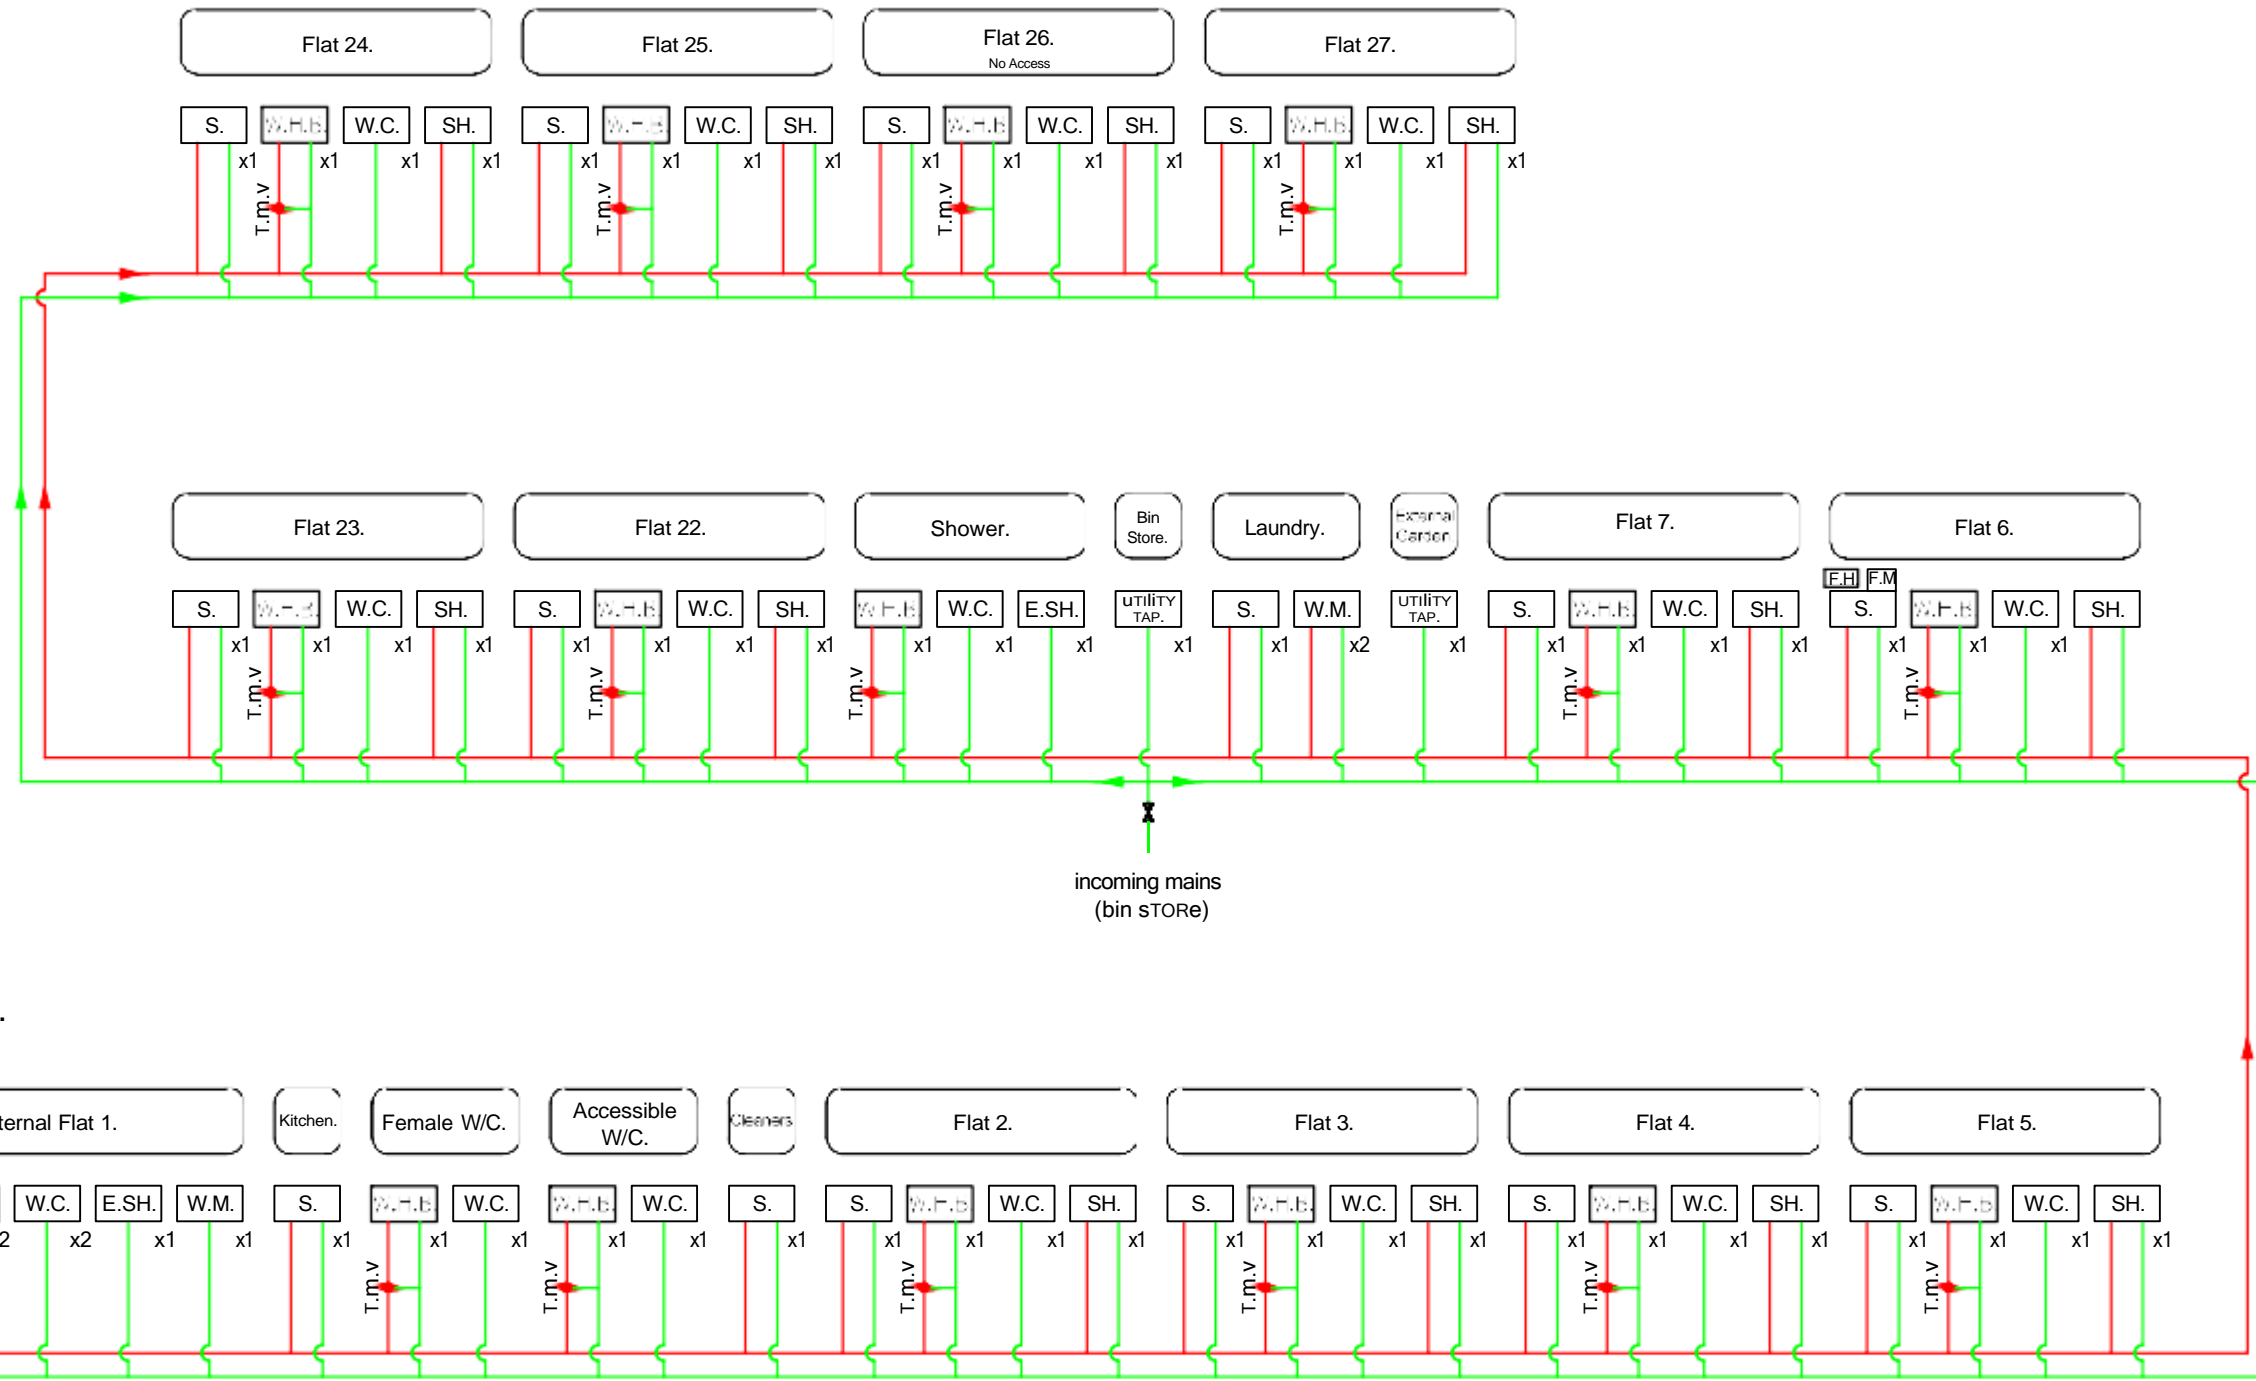

GROUND FLOOR.

SENTINELS		LEGEND.	
F.H	FURTHEST HOT.	RPZ	REDUCED PRESSURE ZONE
EM	FURTHEST MAINS.	T	TEMP GAUGE.
FC	FURTHEST COLD.		
N.H	NEAREST HOT		
N.M	NEAREST MAINS		
N.C	NEAREST COLD.		
M	METER.	Y	TUNDISH.
L.V	LID VENT.	BS	ROBENT SCREEN
S.L	SECURED LID.	ISV	ISOLATION VALVE.
D.L	DEAD LEG.	D.E	DEAD END.
P	PRESSURE GAUGE.	HYDRO	HYDRU BOILER
PV	PRESSURE VESSEL.	ISV (OPEN)	ISOLATION VALVE (OPEN)
	PRESSURE REDUC. VALVE.	ISV (CLOSED)	ISOLATION VALVE (CLOSED)
W.H.B	WASH HAND BASIN.	PRV	PRESSURE REGULATE VALVE
S	SINK.	DL	DRAIN LOCK
W.C	TOILET UNIT.	R	RETURN PUMP.
U	URINAL.	S	SHOAT PUMP.
SH	SHOWER.	NRV	NON-RETURN VALVE
E.SH	ELECTRIC SHOWER.	S	STRAINER.
TAP	TAP.	D.W.D	DRINK WATER DISPENSER.
SL	SLICE SINK.	FLEXI	FLEXI-HOSE.
D.F	DRINKING FOUNTAIN.	CV	CHECK VALVE.
W.M	WASHING MACHINL.	DCV	DOUBLE CHECK VALVE.
D.W	DISH WASHER.	PU	PRESSURISATION UNIT.
W.H	WATER HEATER.	QF	QUICK FILL.
I.W.H	INSTANT WATERHEATER.	D.W.D	DRINK WATER DISPENSER.
filter	FILTER.	PRV	PRESSURE RELIEF VALVE.
WD SH	WASH DOWN SHOWER.		
I.U.O	INFREQUENTLY USED OUTLET		
EXP.	EXPOSED PIPE WORK		
U/D	UNDETERMINED		
HEATING ELEMENTS			
(E)	(S)	(G)	
ELECTRICAL	SOLAR	GAS	
—	—	—	
COLD WATER FLOW		HOT WATER FLOW	
—		—	
MAIN WATER FLOW		RETURN WATER FLOW	
▶	DIRECTIONAL FLOW.		
T.M.V.	Thermostatic Mixing Valve	T.M.T.	Thermostatic Mixing Tap
CLIENT: Believe Housing.			
PROJECT: LEGIONELLA RISK ASSESSMENT Eastington Colliery, Peterlee, Durham, SR8 3ER, Great Britain.			
DRAWING: SCHEMATIC LAYOUT. (2 of 2)			
DATE:	HBE REF:	VERSION:	DRAWN BY:
12/23	643228	V2	T.K

DONNINI HOUSE SHELTERED HOUSING.

HBE Schematics are a representation of the water system. The surveyor uses his/her experience to determine which source supplies the relevant outlet/s. For accurate information on which source supplies each outlet HBE would recommend a dye test is undertaken.

The Frontline Skills Framework - Utilities (5831) - Legionella

is awarded to
Carleton Waite

who attended
Develop Training Limited


This holder has a number of formal Unit Credits by which this Award was achieved

It is recommended that this qualification is renewed after a period of three years

Awarded 24 November 2015

241115/5831-54/023703/TFI3290/M/01/04/89

5501567602/40



Sir John Armitt, CBE FREng FCGI
Chairman
The City and Guilds of London Institute



Chris Jones
Director-General
The City and Guilds of London Institute



CERTIFICATE OF UNIT CREDIT TOWARDS

The Frontline Skills Framework - Utilities (5831) - Legionella

is awarded to
Carleton Waite

who attended
Develop Training Limited

and was successful in the following module

Risk assessment of hot and cold water systems in buildings

Pass

Awarded 24 November 2015

241115/5831-54/023703/TFI3290/MI/01/04/89

5501567602/600



Sir John Armitt, CBE FREng FCGI
Chairman
The City and Guilds of London Institute



Chris Jones
Director-General
The City and Guilds of London Institute

RO1

