

Order Number

1CMP/77388

Job Number

11644



Unit G 16, One Trinity Green, Eldon Street, South Shields, Tyne and Wear. NE33 1SA
Telephone 0191 425 0000 Fax: 0191 425 0037 Registered Number: 7330742

Customer

County Durham Housing Group

Site address

Park Avenue

Door reference

N.A

Door description/ location

Smoke Vents

Order instructions

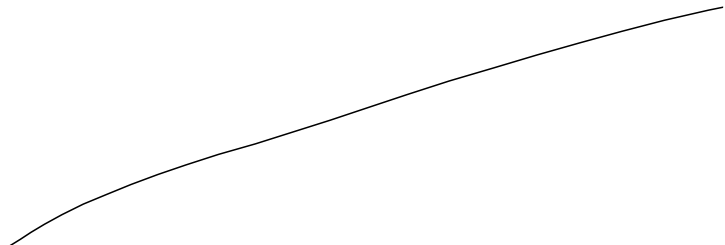
Carry out service visit to smoke vents.

Work detail

Attended site, gained access via codes. Opened up smoke vent control panel, tested mains supply 247v present. Tested battery voltage 2no. 12v present. 24v present on link between batteries. Upon closing panel, fire panel adjacent to smoke vent controller is flashing battery fault. Emailed Stuart Cockburn regarding this issue. Set smoke vents to test mode, ensured all operating correctly, lubricated hinges and tested for structural stability, turned off test mode, ensured all vents closed and hinges pulled window sashes into correct position. No actual fire alarm test carried out.

Engineer: Matt Amar & Malcolm Watson**Date:** 03-Dec-24**Materials**

None.

Completed to my satisfaction**Customer name**

No-one to sign

Comments

None.